

# Empirical Exergy Private Limited (EEPL)



Regd. Office : 18-E, Sudama Nagar, Indore - 452009, (M.P.)  
Office (Indore): Flat No. G-2, 88, Aashirwad Apartment, Indrapuri, Indore (M.P.),  
Contact: +91-731-4948831, Mobile: +91-78693-27256, 88713-68108  
www.eeplgroups.com, email:- eempirical18@gmail.com  
CIN No: U74999MP2018PTC045751

Ref No: EEPL/2019-20/JUNE/C-13

Date: 25/06/2019

## ENERGY AUDIT CERTIFICATE

This is certified that the Energy audit was conducted at **Mewar University, Chittorgarh (Rajasthan)** dated 11/06/2019 to 14/06/2019 (Four Days) and the audit report has been submitted by **Empirical Exergy Private Limited (EEPL), Indore**

We avail this opportunity to express our deep and sincere gratitude to the management for their wholehearted support and co-operations during the energy audit.

This certificate is being issued based on the Energy Audit conducted by EEPL.


For- **Empirical Exergy Private Limited**



**Rajesh Kumar Singadiya (Director)**  
M.Tech (Energy Management),  
Certified Energy Auditor [CEA-7271]  
(BEE, Ministry of Power, Govt. of India)  
Lead Auditor ISO50001:2011 [EnMS] from FICCI, Delhi  
Certified Water Auditor (NPC, Govt of India)



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2018-19**



# **ENERGY AUDIT REPORT**



**MEWAR UNIVERSITY**  
**Gangrar Chittorgarh (Rajasthan )**

PREPARED BY

**EMPIRICAL EXERGY PRIVATE LIMITED**

Flat No. 201, OM Apartment, 214 Indrapuri Colony,  
Bhawarkuan, Indore – 452 001 (M. P.), India  
0731-4948831, 7869327256


Email ID: [eempirical18@gmail.com](mailto:eempirical18@gmail.com)

[www.eeplgroups.com](http://www.eeplgroups.com)

**(2018-19)**



**Energy Audit Report**  
**Mewar University, Gangrar Chittorgarh**  
**(Rajasthan ) Year 2018-19**




## CONTENT

Sr. No	Item	Page No.
<b>I</b>	<b>Acknowledgement</b>	<b>3</b>
<b>II</b>	<b>Certification Of Accreditation</b>	<b>4</b>
<b>III</b>	<b>Green Monitoring Committee</b>	<b>5</b>
<b>IV</b>	<b>The Audit Team</b>	<b>6</b>
<b>V</b>	<b>Executive Summary</b>	<b>7</b>
<b>Chapter-1</b>	<b>Introduction</b>	<b>8</b>
1.1	About University	8
1.2	About University Campus	11
1.3	Mewar University Layout Of Various Buildings	14
1.4	About Energy Audit	15
1.5	Objectives Of Energy Auditing	15
1.6	Methodology:	16
1.7	Mewar University Present Energy Scenario:	17
<b>Chapter- 2</b>	<b>Power Supply System</b>	<b>18</b>
2.1	Power Station & Transformer:	18
2.2	DG Sets	19
2.3	Capacitor Bank	20
2.4	Grid Connected Solar Photovoltaic System (480 KWp)	21
<b>Chapter- 3</b>	<b>Electricity Bill Analysis</b>	<b>23</b>
3.1	Monthly Electrical Energy Consumption (2018-19) University Feeder	23
3.2	Monthly Demand Analysis (2018-19) University Feeder	24
3.3	Monthly Power Factor Analysis: Year (2018-19) University Feeder	25
3.4	Monthly Electrical Energy Consumption (2018-19) Residency Feeder	26
3.5	Monthly Demand Analysis (2018-19) Residency Feeder	27
3.6	Monthly Power Factor Analysis: Year (2018-19) Residency Feeder	28
3.7	Some Photographs Of Electrical Equipments	29



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2018-19**



## **ACKNOWLEDGEMENT**

**Empirical Exergy Private Limited (EEPL), Indore (M.P)** takes this opportunity to appreciate & thank the management of **Mewar University, Gangrar, Chittorgarh** for allowing us to conduct an energy audit for the university.

We are indeed touched by the helpful attitude and co-operation of all faculties and technical staff, who rendered their valuable assistance and co-operation during the course of study.

**Rajesh Kumar Singadiya**

**(Director)**

M.Tech (Energy Management), PhD (Research Scholar)

Accredited Energy Auditor [AEA-0284]

Certified Energy Auditor [CEA-7271]

(BEE, Ministry of Power, Govt. of India)

Empanelled Energy Auditor with MPUVN, Bhopal M.P.

Lead Auditor ISO50001:2011 [EnMS) from FICCI, Delhi


Certified Water Auditor (NPC, Govt of India)

Chartered Engineer [M-1699118], The Institution of Engineers (India)

Member of ISHRAE [58150]




## Certification Of Accreditation

**BUREAU OF ENERGY EFFICIENCY**

Examination Registration No.: ..... **EA- 7271** .....

Accreditation Registration No.: ..... **AEA-284** .....



### Certificate of Accreditation

This is to certify that Mr./Ms. **Shri. Rajesh Kumar Singadiya** ..... having its trade/registered office at ..... has been given accreditation as accredited energy auditor. The certificate shall be effective from **9<sup>th</sup>** day of **May, 2018** .....


The certificate is subject to the provisions of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

This certificate shall be valid until it is cancelled under regulation 9 of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

On cancellation, the certificate of accreditation shall be surrendered to the Bureau within fifteen days from the date of receipt of order of cancellation.

Your name has been entered at AEA No. **284** ..... in the register of list of accredited energy auditors. Your name shall be liable to be struck out on the grounds specified in regulation 8 of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

Given under the seal of the Bureau of Energy Efficiency, Ministry of Power, this **5<sup>th</sup>** day of **October, 2018**

  
Secretary,  
Bureau of Energy Efficiency  
New Delhi



**Green Monitoring Committee.**

**OFFICE OF THE REGISTRAR  
MEWAR UNIVERSITY, GANGRAR, CHITTORGARH (RAJ.)**

Ref. No.MU/RO/2019/2177

25/02/2019

**OFFICE ORDER**

**Reconstitution of Green, Environment & Energy Auditing Committee.**

Green Audit, Environment Audit & Energy Audit Committee is reconstituted to conduct the necessary audit in due course. Members of the Audit Committee are mentioned below:

Sr. No.	Name	Designation	Committee
1	Dr. Satish Kumar Sharma	Professor, Department of Agriculture	Co-Ordinator
2	Mr. Rakesh Kumar Singadiya	Director, Empirical Exergy Pvt.Ltd.	External Auditor
3	Mr. K.K. Bhati	Asst. Professor, Department of Agriculture	Internal Auditor
4	Dr. Satish Kumar Ameta	Asst. Professor, Department of Life Science	Internal Auditor
5	Mr. Deepak Kumar Joshi	Asst. Professor, Department of Electrical Engineering	Internal Auditor
6	Dr. Mohammad Ashid	Asst. Professor, Department of Chemistry	Member
7	Mr. Suraj Kumhar	Asst. Professor, Department of Electrical Engineering	Member
8	Mr. Brijesh Kumar Meena	Asst. Professor, Department of Agriculture	Member
9	Mr. H. Widhani	OSD	Member
10	Mr. Narendra Kumar Ved	Non-Teaching Staff	Member
11	Mr. Rajesh Sharma	Non-Teaching Staff	Member

**Copy to:**

1. PS to Hon'ble Chancellor (for kind information)
2. PS to Hon'ble President/Vice Chancellor(for kind information)
3. All Officers/Deans/Directors/Hod's
4. IT Section/Accounts Dept./All Staff
5. Coordinator – IQAC Cell
6. Record File

  
**Registrar**  
**Mewar University**  
**Gangrar, (Chittorgarh)**




**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2018-19**



**The Audit Team**

The study team constituted of the following senior technical executives from **Empirical Exergy Private Limited,**

- ✚ **Mr. Rajesh Kumar Singadiya** [ Director & Accredited Energy Auditor AEA-0284]
- ✚ **Mr. Rakesh Pathak,** [Director & Electrical Expert]
- ✚ **Dr. Suresh Kumar Soni** [Certified Energy Auditor & Energy Expert]
- ✚ **Mr. Sachin Kumawat** [ Sr. Project Engineer]
- ✚ **Mr. Aakash Kumawat** [Site Engineer]
- ✚ **Mr. Ajay Nahra,** [Sr. Accountant & admin ]



## **EXECUTIVE SUMMARY**

The executive summary of the energy audit report furnished in this section briefly gives the identified energy conservation measures and other recommendations during the project that can be implemented in a phased manner to conserve energy and increase productivity inside the university campus.

### **ENERGY MANAGEMENT INITIATIVE TAKEN BY UNIVERSITY**

#### **✚ 480 KWp SOLAR PHOTOVOLTAIC ROOFTOP INSTALLATION**

University has a 480 KWp solar photovoltaic rooftop grid-connected system installed on various buildings. Total unit generation from Sep-2018 to June 2019 is **4,15,350** units.

### **RECOMMENDATION:-**

#### **✚ POWER FACTOR IMPROVEMENT ON UNIVERSITY FEEDER**


The average power factor for the year 2018-19 was 0.902 on the university feeder. It is recommended to maintain the power factor unity.

#### **✚ CEILING FAN AND EXHAUST FAN:**

University is going to replace “conventional ceiling fan (60 Watt )” with an energy-efficient star-rated fan or BLDC-based energy-efficient fan (28 Watt) in classrooms, laboratories, and faculties cabin in phased manner and has great potential for energy saving.

University is going to replace the “conventional exhaust fan (180 Watt)” with an energy-efficient star-rated fan or BLDC-based energy-efficient Fan (40 Watt) in the university's main building classrooms, laboratories, and faculties cabin has great energy-saving potential.





## **CHAPTER-1 INTRODUCTION**

### **1.1 About University**

Mewar University is an autonomous body set up by the Government of Rajasthan through Act. No. 4 of 2009 passed by the Rajasthan Legislative Assembly (Government of Rajasthan). The University is recognized by the UGC u/s 2(f) of UGC Act with powers to confer degrees u/s 22(1) of the UGC Act, 1956 vide their letter no. F.9-15/2009(CPP-I) dated 30<sup>th</sup> March 2009. This is the only private and self-financed University in Rajasthan which is also approved by the UGC u/s 12B of the UGC Act vide their letter No. F.9-15/2009 (CPP-I/PU) dated 15<sup>th</sup> October 2018. The University is also NAAC accredited.

Mewar University has never affiliated any institution, nor has the University ever set up any study center in any part of the country other than its main campus at Gangrar in Chittorgarh (Rajasthan).

Mewar University is promoted by the Mewar Education Society (MES). It is controlled by a Board of Management, constituted by the MES, which is headed by Chairperson Shri Ashok Kumar Gadiya, a great visionary, educationist, and nationalist, who translated his ideas and dreams of promoting higher education into reality by setting up institutes of learning in various subjects. In no time, he has carved out a niche for himself as an educationist, who believes in the inculcation of values through education in the young generation.

The group, under the able leadership of Dr. Ashok Kumar Gadiya and the active support and association of renowned academicians, experienced professionals, and technocrats, has established a chain of Institutes of higher education and learning:

#### **Mewar Institute of Management**


Mewar Institute of Management, Vasundhara, Ghaziabad (U.P.) [Approved by the UGC and affiliated with C.C.S. University, Meerut, conducting courses for B.B.A., M.B.A., B.C.A., M.C.S., M.I.S., B.Ed, B.Lib, and M.Sc. (Biotech)]

#### **Mewar Law Institute**

Mewar Law Institute, Vasundhara, Ghaziabad (U.P.) [Approved by the UGC, Bar Council of India and affiliated to C.C.S. University, Meerut, conducting courses for L.L.B. (3Yrs) & L.L.B. (5Yrs)]



## **Energy Audit Report Mewar University, Gangrar Chittorgarh (Rajasthan ) Year 2018-19**



### **+ Mewar Girls Business School**

Mewar Girls Business School, Vasundhara, Ghaziabad (U.P.) [Approved by the AICTE and affiliated to UP Tech University, Lucknow, conducting M.B.A. courses for Girls]

### **+ Mewar Girls College**

Mewar Girls College, Chittorgarh [Approved by Government of Rajasthan and affiliated to Mohan Lal Sukhadia University, Udaipur, conducting courses for M.I.B., B.Sc (Biotech.), B.B.M., B.C.A. & P.G.D.C.A.]

### **+ Mewar Girls Ayurved Nursing Centre**

Mewar Girls Ayurved Nursing Centre, Chittorgarh [Approved by Government of Rajasthan and affiliated to Rajasthan Ayurved University, Jodhpur, conducting courses for Ayurved Nursing]

### **+ Mewar Girls Industrial Training Centre**

Mewar Girls Industrial Training Centre, Chittorgarh [Approved by Government of India (NCVT) and Board of Technical Education, Jodhpur, (SCVT), conducting courses for Computer Operator and Programming Assistant, Interior Decoration, Fashion Designing, Dress Making, English Language Proficiency and Personality Development]

### **+ Mewar Girls College of Teachers Training**

Mewar Girls College of Teachers Training, Chittorgarh [Approved by Government of India (NCTE) and affiliated to Mohan Lal Sukhadia University, Udaipur, conducting courses for B.Ed., N.T.T, S.T.C]


These centers of learning exemplify the group's mission to promote quality technical and higher education. And as a result, the number of students has gone up considerably, and now it has more than 10,000 students on its campuses.

The group, continuing with its mission to provide higher and technical education to a larger section of people, has touched a new height by promoting and sponsoring Mewar University. The promoting body, with its honest efforts and unstinting dedication, has the conviction to build a strong partnership with the Government of Rajasthan for ensuring the spread of higher and technical education in the state.

Mewar's culture, ethos, tradition, and values are so ingrained in its soil that it is bestowed with the magical powers to sprout prodigious talent and genius. Anyone groomed in this environment will undergo a steady transformation to blossom in life and imbibe the traits of greatness associated with this historical place.



**Energy Audit Report**  
**Mewar University, Gangrar Chittorgarh**  
**(Rajasthan ) Year 2018-19**



**VISION:-**

To develop a center of excellence for technical, professional, and vocational education and research at par with national and international standards.

**MISSION:-**


To develop the framework for effectively conducting various educational and research programmes of the highest standards to produce confident, self-reliant, and responsible youth for society and outstanding professionals for government, industry, and business. The mission is to "**Reach the unreached**"

**OBJECTIVE:-**

- ❖ Provide easy access to high-quality education in Management, Engineering, as well as other academic & professional fields to its students, irrespective of their caste, creed, age, gender, region, or country, at an affordable cost.
- ❖ To offer a conducive environment for pursuing research and vocational studies with a market-driven orientation.
- ❖ To expose students to new ideas, fresh vision, and pragmatic ambition and enhance their competency in the ever-changing business environment.
- ❖ To provide a flexible choice-based credit system of education and dual-degree programmes while flexible adopting modes of delivery to suit students' requirements of learning.
- ❖ To prepare and assist students in improving their prospects through career counseling and placement support, on-the-job training, industrial visits, presentations, and group discussions.
- ❖ To Promote and practice a convenient distance education concept in India and abroad.
- ❖ To spread job-oriented Skill Development education in rural and tribal areas



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2018-19**




**1.2 About Campus: -**

Table 1.1 Details are the total build-up area given in the table:-


<b>TOTAL GROUND COVERED. =20856.78 SQ.MT</b>									
<b>TOTAL OVERALL BUILT-UP ALL FLOORS AREA:- 76024.72 SQ.MT</b>									
S.NO	BLOCK	FAR AREA				BUILT AREA			
		GROUND FLOOR AREA IN SQ.MT	FIRST FLOOR AREA IN SQ.MT	SECOND FLOOR AREA IN SQ.MT	THIRD FLOOR AREA IN SQ.MT	GROUND FLOOR AREA IN SQ.MT	FIRST FLOOR SQ.MT	SECOND FLOOR AREA IN SQ.MT	THIRD FLOOR AREA IN SQ.MT
1	ADMINISTRATIVE AND ACADEMIC BLOCK	8890.84	8519.33	8675.24	8675.24	8966.05	9050.97	9206.74	9206.74
2	EDUCATION BLOCK	1062.08	1170.08	1062.08	1062.1	1193.08	1253.27	1126.29	1126.29
3	ENGINEERING BLOCK	1979.9	11979.9	1979.9	0	2126.84	2093.74	2093.74	0
4	MEWAR HOSPITAL	1337.03	1337.03	0	0	1590.91	1590.91	0	0
5	BHAMASHAH HOSTEL	1382.11	1382.11	1382.11	1382.1	1601.64	1572.82	1572.82	1572.82
6	SANGA HOSTEL	1189.78	1189.78	1189.78	1189.8	1359.6	1341.62	1341.62	1341.62
7	KUMBHA HOSTEL	602.71	602.71	620.65	620.65	709.19	697.35	697.35	697.35
8	PRATAP HOSTEL	640.52	640.52	665.78	665.78	749.38	739.64	739.64	739.64



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2018-19**



S.NO	BLOCK	FAR AREA				BUILT AREA			
		GROUND FLOOR AREA IN SQ.MT	FIRST FLOOR AREA IN SQ.MT	SECOND FLOOR AREA IN SQ.MT	THIRD FLOOR AREA IN SQ.MT	GROUND FLOOR AREA IN SQ.MT	FIRST FLOOR SQ.MT	SECOND FLOOR AREA IN SQ.MT	THIRD FLOOR AREA IN SQ.MT
9	PANNA DHAI HOSTEL	376.53	376.53	382.3	382.3	447.6	435.97	435.97	435.97
10	MEERA HOSTEL	323.13	323.13	323.13	323.13	386.87	381.68	381.68	381.68
11	GUEST HOUSE	229.94	223.58	223.58	223.58	295.78	258.82	258.82	258.82
12	STAFF QUARTERS(1 BHK)	285.11	285.11	285.11	285.11	367.6	362.67	362.67	362.67
13	STAFF QUARTER	276.99	276.99	276.99	276.99	353.84	349.18	349.18	349.18
14	ANNAPURNA MESS	613.7	0	0	0	708.4	0	0	0
	<b>TOTAL</b>	19190.37	28306.8	17066.65	15086.78	20856.78	20128.64	18566.52	16472.78



**Satellite Image of Mewar university from Google map**



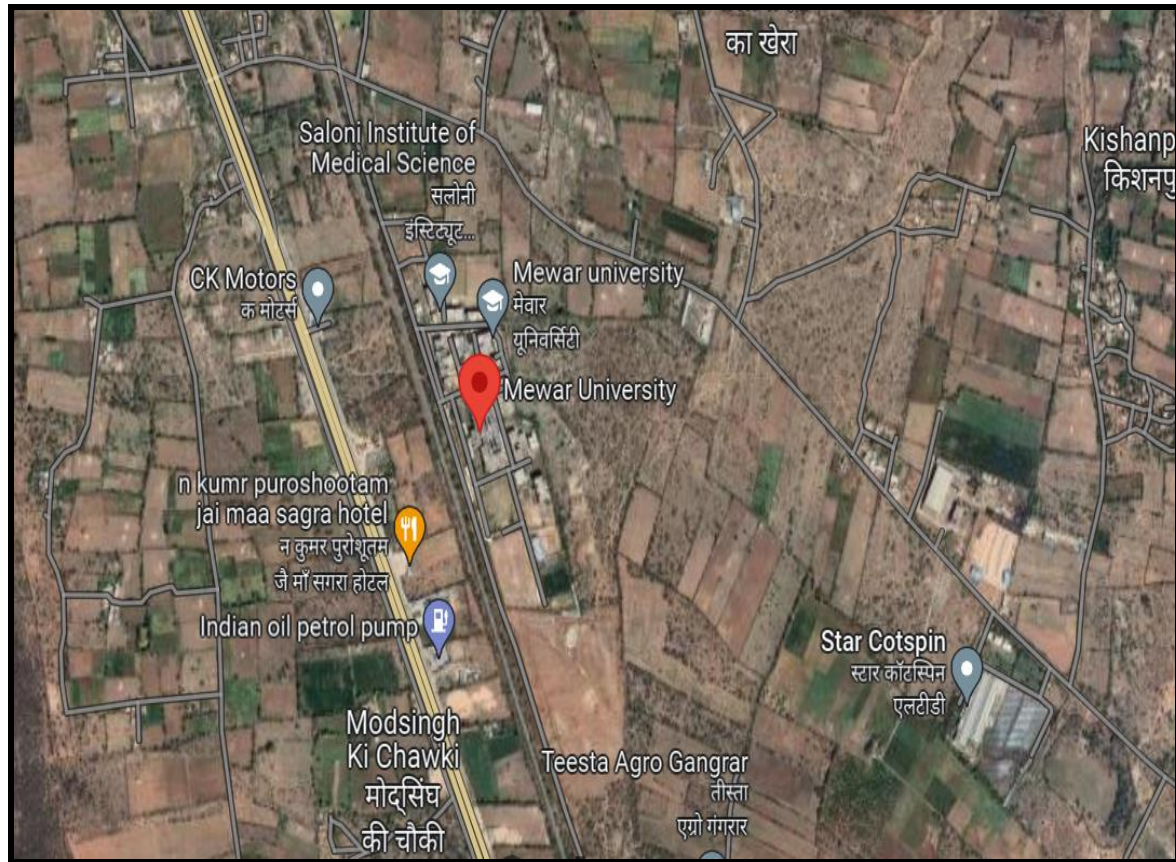


Figure 1.1: - Satellite Image of Mewar university from Google map




### 1.3 MEWAR UNIVERSITY LAYOUT OF VARIOUS BUILDINGS

Layout map of Mewar University

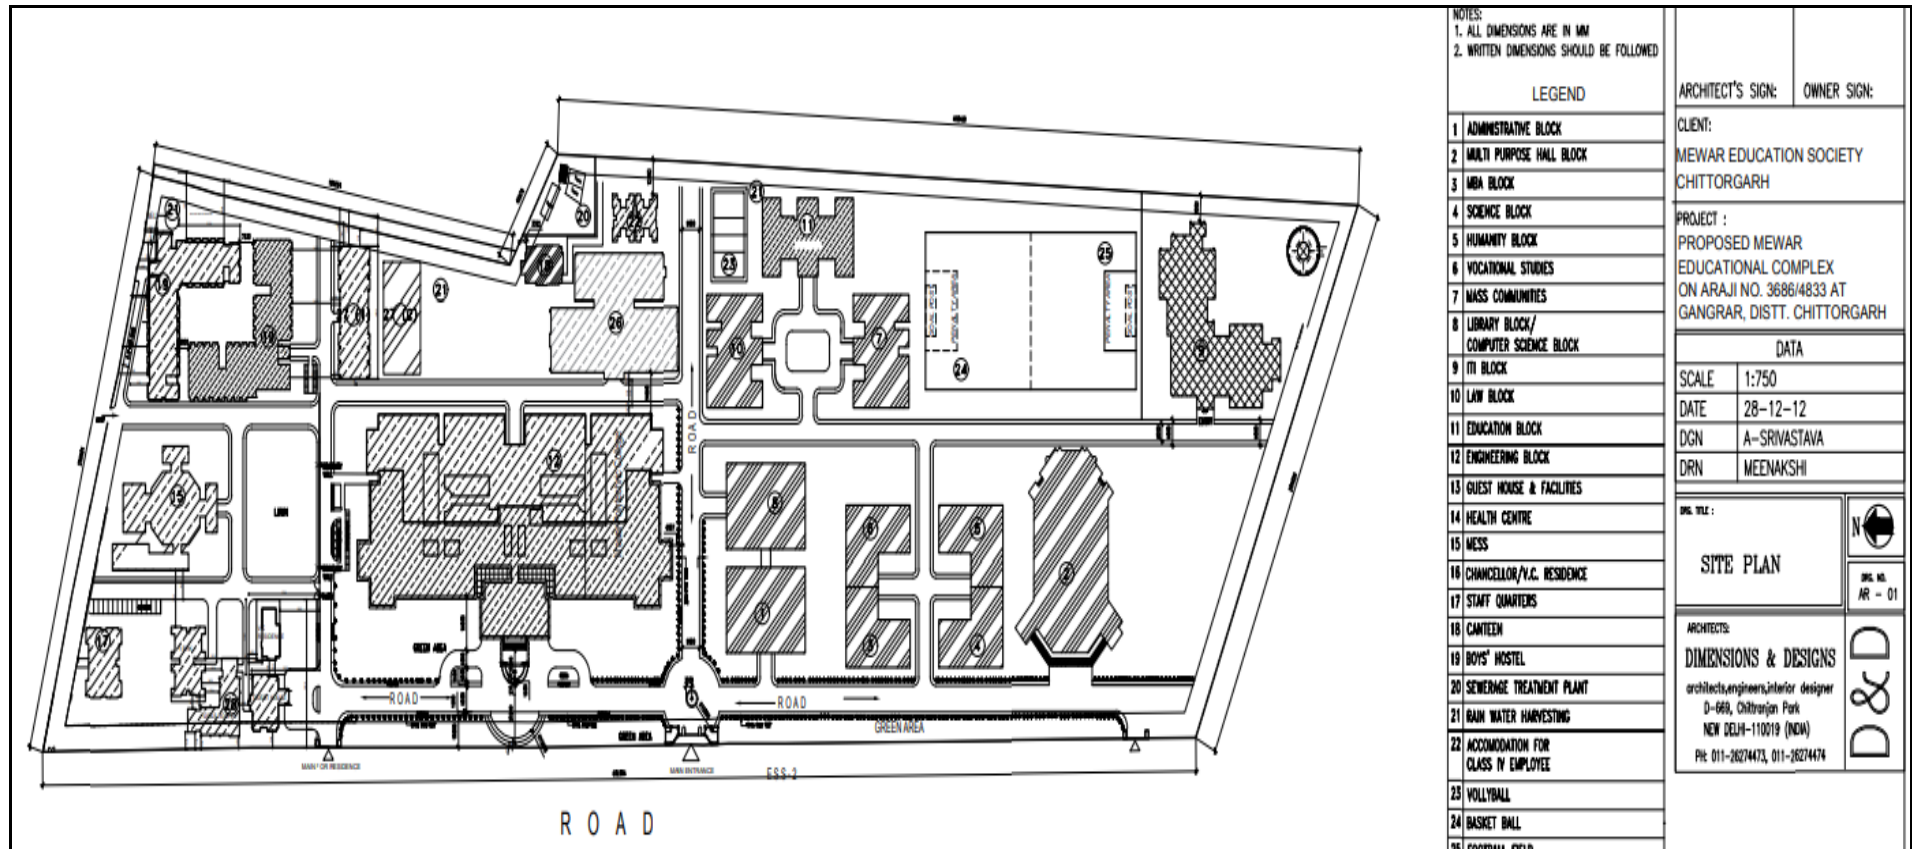



## Energy Audit Report Mewar University, Gangrar Chittorgarh (Rajasthan ) Year 2018-19



### 1.4 About Energy Audit

An energy audit helps to understand more about the ways energy is used in any plant and helps in identifying areas where waste may occur and scope for improvement exists. The overall energy efficiency from generation to the final consumer becomes 50%. Hence one unit saved in the end user is equivalent to two units generated in the power plant.

An energy audit is the most efficient way to identify the strength and weaknesses of energy management practices and to find a way to solve problems. An energy audit is a professional approach to utilizing economic, financial, social, and natural resources responsibly. Energy audits “adds value” to management control and are a way of evaluating the system.


**Empirical Exergy Private Limited (EEPL)**, Indore M.P. carried out the “Energy Audit” at the site to find gaps in the energy consumption pattern for **Mewar University, Chittorgarh**. A technical report is prepared as per the need and the requirement of the project.

### 1.5 Objectives of Energy Auditing

An energy audit provides a vital information base for an overall energy conservation program covering essentially energy utilization analysis and evaluation of energy conservation measures. It aims at

- Identifying the quality and cost of various energy inputs.
- Assessing the present pattern of energy consumption in different cost centers of operations.
- Relating energy inputs and production output.
- Identifying potential areas of the thermal and electrical energy economy.
- Highlighting wastage in major areas.
- Fixing of energy-saving potential targets for individual cost centers.
- Implementation of measures for energy conservation & realization of savings.






## 1.6 Methodology

The methodology adopted for achieving the desired objectives viz.: Assessment of the current operational status and energy savings includes the following:

- ✚ Discussions with the concerned officials for identification of major areas of focus and other related systems.
- ✚ A team of engineers visited the site and had discussions with the concerned officials/supervisors to collect data/information on the operations and load distribution within the plant and the same for the overall premises. The data were analyzed to arrive at a baseline energy consumption pattern.
- ✚ Measurements and monitoring with the help of appropriate instruments including continuous and/or time-lapse recording, as appropriate and visual observations were made to identify the energy usage pattern and losses in the system.
- ✚ Trend analysis of costs and consumptions.
- ✚ Capacity and efficiency test of major utility equipments, wherever applicable.
- ✚ Estimation of various losses
- ✚ Computation and **in-depth analysis** of the collected data, including utilization of computerized analysis and other techniques as appropriate, were done to draw inferences and to evolve suitable energy conservation plan/s for improvements/reduction in specific energy consumption.



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2018-19**




### **1.7 Mewar university present energy scenario**

Mewar university uses energy in the form of electricity purchased from the grid and a 480 KWp solar grid-connected system for the university campus. There are two feeders one is for education building and the other for residency.

The annual energy consumption of **Mewar University** campus is about **7,81,889** units (Grid + Solar ) period from 2018-19

Mewar University has a 480 KWp solar photovoltaic rooftop grid-connected system installed on almost all buildings. Total solar generation from Sep-2018 to July-2019 is 4,15,350 units. Annual Solar unit generation for the year 2018-19 is 4,15,350 units.



## CHAPTER- 2 POWER SUPPLY SYSTEM

### 2.1 Transformers

The power supply for the mewar university is from AVVNL with the help of 11 kV feeders. There are 3 electricity connections. One is a university feeder under Tariff 2620G 11 KV. Non-Industrial with sanctioned load of 425 kW. The second is a residency feeder under tariff 1011, 11 KV non-industrial with sanctioned load of 400 kW, and the third are bank feeder with 14 kW. There are two step-down transformers having capacities are 630 KVA and 500 KVA. university and residential respectively. The details are given in following table 2.1

Table: 2.1 Nameplate details of transformers -01 and 02

Sr. No.	Items	Technical Specification of Transformer -01 (University Feeder)	Technical Specification of Transformer -02 (Residency Feeder)
1	Make	Ganga Sagar Agro Pipes Private Limited	Uttam (Bharat) Electrical Private Limited
2	Year	2008	2012
3	Rating (kVA)	630	500
4	Voltage (HV/ LV)	11000/433	11000/433
5	Current Rating (HV/ LV)	33.10 / 838	26.24/666.71
6	Frequency (Hz)	50	50
7	Impedance at 75°C (%)	4 %	4 %
8	Vector group	Dyn-11	Dyn-11
9	Type of cooling	ONAN	ONAN
10	Total no of Tap	5	5



Figure 2.1:- 11 kV Feeder and 630 kVA and 500 kVA

## 2.2 DG Set:-

There are 2 DG sets on the university campus. Details of the DG Sets are given table. 2.2

Table 2.2 Technical specifications for DG sets- 01 and 02

Sr. No.	Parameter	Technical Specification DG Set-01 (University Feeder)	Technical Specification DG Set-02 (Residency Feeder )
1	Make	Stamford	Stamford
2	M/C No	N136288779	N02609855
3	Capacity (KVA)	250	200
4	Rated Voltage	415	415
5	Full load current	347.8	278
6	Frequency	50	50
7	Power factor	0.8	0.8
8	RPM	1500	1500
9	Phase	3	3



Figure 2.2:- DG set in the university

### Observation

- DG set is used only in case of grid power failure.
- There is no system to monitor fuel consumption w.r.t. unit generation.



### 2.3 Capacitor Bank

The energy audit team examine of existing capacitor bank at the power house. Details of the capacitor are given in table 2.3

Table: 2.3 Details of Capacitor bank

Sr. no	Capacitor no	Capacity	Location	Remark
1	Capacitor -01	5 kVAr	Main University Panel	Working
2	Capacitor -02	5 kVAr	Main University Panel	Working
3	Capacitor -03	5 kVAr	Main Residential Panel	Working
4	Capacitor -04	5 kVAr	Main Residential Panel	Working



Figure 2.3 Capacitor bank on main panel

#### Observation:-

Energy audit team examine individual capacitors at the site. It was found that all the capacitors are in working condition.



#### 2.4 Grid Connected Solar Photovoltaic System (490 Kwp)

There is a 480KWp solar photovoltaic rooftop grid-connected system installed on various buildings. System details are given below:

Table: - 2.4 Solar plant detailed


Sr. No	Description	Technical Specification
1	Plant Information	
1.1	Plant capacity	480 kWp
1.2	Locations	1. Administrative and Academic building 2. Kumbha Hostel building. 3. Pratap Hostel building. 4. Sanga Hostel building. 5. Mewar Hospital 6. Panna Dhai Girls Hostel . 7. Meera Girls Hostel.
1.3	Latitude & Longitude	23.3103 N & 77.3619 E
2	PV Panel Details	
2.1	Make	M/s. Goldi Green Technologies Pvt. Ltd
2.2	Panel Type	Poly-crystalline
2.3	Panel Wattage	320 Wp
2.4	No of PV Panels	1478
2.5	Total Capacity	480 kWp
3	Inverter Information	
3.1	Make	KSTAR
3.2	Model	1. KSG-50K = 04 2. KSG-20K = 06 3. KSG-15K = 01 4. KSG-20K =05
3.3	Capacity	480 Kw

Sr. No	Building Name	Total No of Inverter	Inverter Modal	No of Penal
1	Administrative and Academic building	2	KSG-20 K	730
		4	KSG-50 K	
2	Kumbha Hostel	2	KSG-20 K	110
3	Pratap Hostel	1	KSG-15 K	108
		1	KSG-20 K	
4	Sanga Hostel	2	KSG-30 K	190
5	Mewar Hospital	2	KSG-30 K	190
6	Panna Dhai Hostel	1	KSG-20 K	60
7	Meera Girls Hostel	1	KSG-30 K	90

Photographs of solar plant:-



Figure 2.4:- Solar plant 480 KWp and inverter system



**CHAPTER- 3  
ELECTRICITY BILL ANALYSIS**

**3.1 Monthly electrical energy consumption 2018-19:- (University Feeder )**

The monthly electrical consumption for the university is given in the table.

Table 3.1 Energy consumption and billing amount (the year 2018-19)

Sr. No.	Month & Year	Total Unit Consumption (kWh)	Total Amount (Rs/-)	Overall Per Unit Charge (Rs/kWh)
1	Jul-18	32,136	2,39,054/-	7.44
2	Aug-18	48,354	3,83,078/-	7.92
3	Sep-18	44,612	3,23,125/-	7.24
4	Oct-18	21,880	2,43,811/-	11.14
5	Nov-18	21,736	2,51,670/-	11.58
6	Dec-18	13,068	1,56,710/-	11.99
7	Jan-19	29,668	3,21,445/-	10.83
8	Feb-19	21,092	2,30,092/-	10.91
9	Mar-19	22,413	2,43,180/-	10.85
10	Apr-19	22,908	2,53,377/-	11.06
11	May-19	42,320	3,13,884/-	7.42
12	Jun-19	46,352	3,49,761/-	7.55
	<b>Total</b>	<b>3,66,539</b>	<b>33,09,187/-</b>	<b>9.66</b>


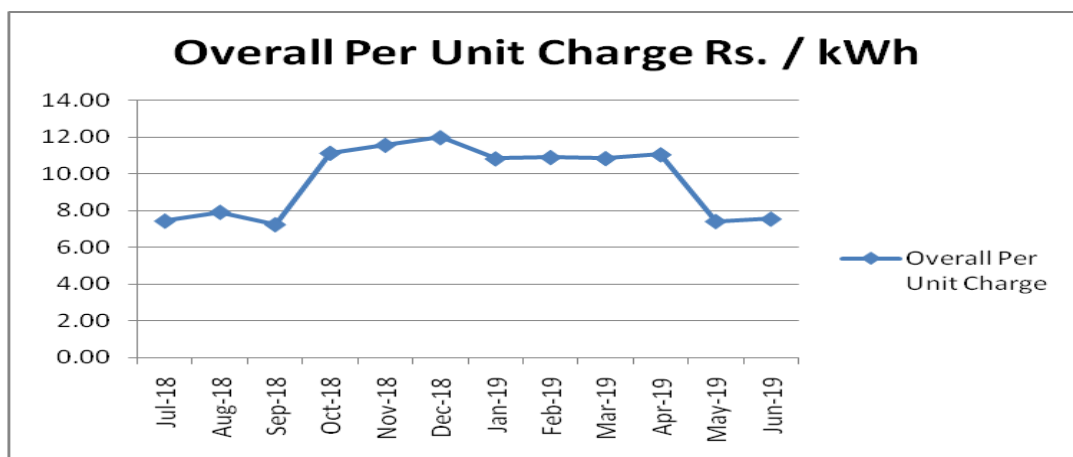


Figure 3.1:- Graphical presentation of actual per-unit charges for the year 2018-19

**Observation:**

It was found that total energy consumption in the last 12 months was 3,66,539 units. The average annual energy charge is Rs 9.66 /kWh.





### 3.2 Monthly demand analysis (2018-19) at University feeder.

The monthly demand consumption for the university is given in the table.

Table 3.2:- Monthly demand analysis (KVA) consumption pattern year 2018-19

Sr. No.	Month & Year	Contract Demand (KVA)	Billing Demand (KVA)	Maximum Demand (KVA)
1	Jul-18	300	225	105
2	Aug-18	300	225	253
3	Sep-18	300	225	130
4	Oct-18	300	225	137
5	Nov-18	300	225	137
6	Dec-18	300	225	137
7	Jan-19	300	225	176
8	Feb-19	300	225	165
9	Mar-19	300	225	171
10	Apr-19	300	225	161
11	May-19	300	225	188
12	Jun-19	300	225	94
Minimum Demand (KVA)				<b>94</b>
Maximum Demand (KVA)				<b>253</b>
Average Demand (KVA)				<b>149.8</b>


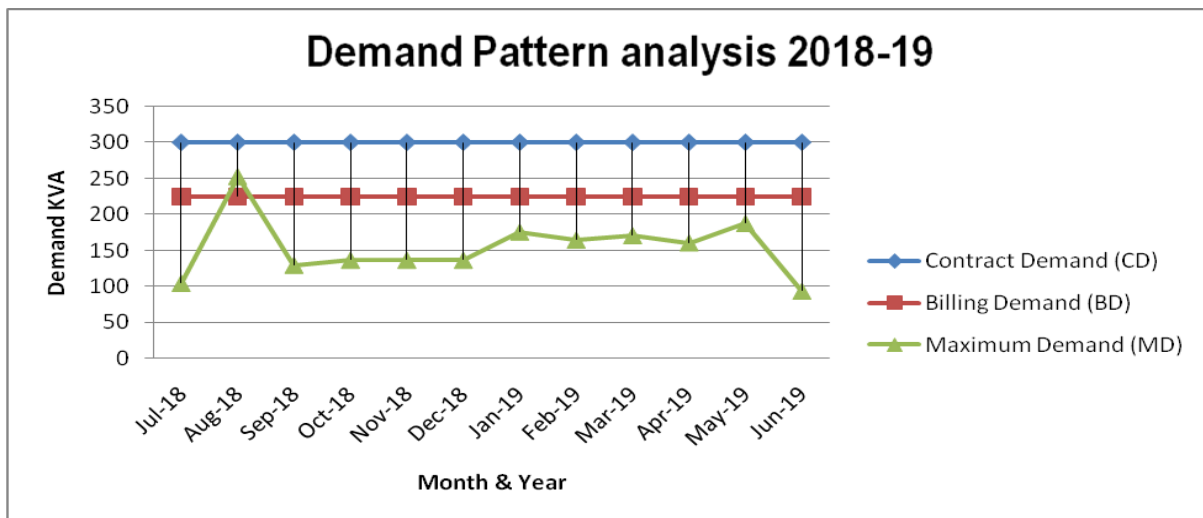


Figure 3.2:- Graphical presentation of demand consumption in the university year 2018-19

**Observation:** It was observed that the contract demand of the university is 300 kVA. There is a variation in maximum demand. It is a maximum of 253 kVA and a minimum of 94 kVA



**3.3 Monthly Power factor analysis Year-2018-19 (University Feeder )**

The monthly power factor for the university is given in the following table.

Table 3.3:- Power factor of the university year 2018-19

Sr. No.	Month & Year	Power Factor (PF)	PF Incentive (%)	PF Surcharge (Rs/-)
1	Jul-18	0.864	0	8,254
2	Aug-18	0.877	0	7,940
3	Sep-18	0.931	0	0
4	Oct-18	0.946	0	0
5	Nov-18	0.927	0	0
6	Dec-18	0.823	0	7,158
7	Jan-19	0.941	0	0
8	Feb-19	0.923	0	0
9	Mar-19	0.932	0	0
10	Apr-19	0.926	0	0
11	May-19	0.761	0	6,345
12	Jun-19	0.974	4,683	0
		<b>0.902</b>	<b>4,683</b>	<b>29,697</b>


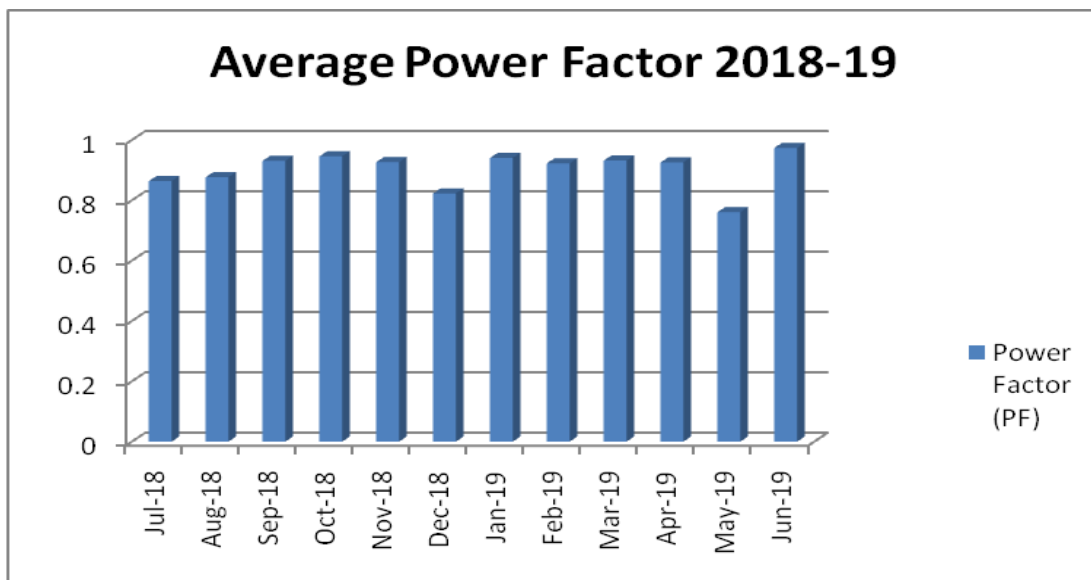


Figure 3.3 Graphical presentation of average power factor year 2018-19

**Observation:**

The average power factor was 0.902 for the year 2018-19. It is recommended to maintain power factor unity.



### 3.4 Monthly electrical energy consumption 2018-19 at (Residency Feeder )

The monthly electrical consumption for the university is given in the table.

Table 3.4 Energy consumption and billing amount year 2018-19

Sr. No.	Month & Year	Total Unit Consumption (kWh)	Total Amount (Rs/-)	Overall Per Unit Charge (Rs/kWh)
1	Jul-18	48,344	4,90,035/-	10.14
2	Aug-18	35,680	3,67,344/-	10.30
3	Sep-18	46,712	4,80,311/-	10.28
4	Oct-18	18,968	1,89,106/-	9.97
5	Nov-18	13,504	1,72,810/-	12.80
6	Dec-18	71,28	1,05,755/-	14.84
7	Jan-19	3,680	74,732/-	20.31
8	Feb-19	7,362	98,080/-	13.32
9	Mar-19	4,439	66,072/-	14.88
10	Apr-19	3,309	43,650/-	13.19
11	May-19	3,542	43,650/-	12.32
12	Jun-19	24,248	252,219/-	10.40
	<b>Total</b>	<b>2,16,916</b>	<b>23,83,764/-</b>	<b>12.73</b>


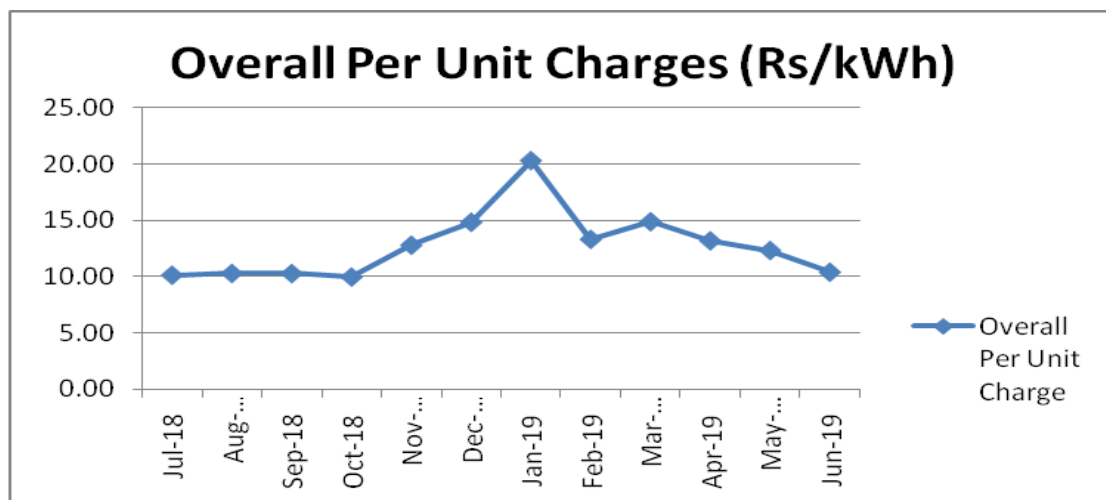


Figure 3.4:- Graphical presentation of actual per-unit charges for years 2018-19

#### Observation:

It was found that total energy consumption in the last 12 months was 2,16,916 units. The average annual energy charge is 12.73 Rs/kWh.



### 3.5 Monthly Demand analysis (2018-19) on (Residency Feeder )

The monthly demand consumption for the residency feeder is given in the table.

Table 3.5 Monthly demand analysis (KVA) consumption pattern year 2018-19

Sr. No.	Month & Year	Contract Demand (KVA)	Billing Demand (KVA)	Maximum Demand (KVA)
1	Jul-18	300	225	126
2	Aug-18	300	225	314
3	Sep-18	300	225	132
4	Oct-18	300	225	93
5	Nov-18	300	225	116
6	Dec-18	300	225	95
7	Jan-19	300	225	66
8	Feb-19	300	225	72
9	Mar-19	300	225	72.8
10	Apr-19	300	225	72
11	May-19	300	225	72
12	Jun-19	300	225	107
Minimum Demand (KVA)				<b>66</b>
Maximum Demand (KVA)				<b>314</b>
Average Demand (KVA)				<b>111.5</b>


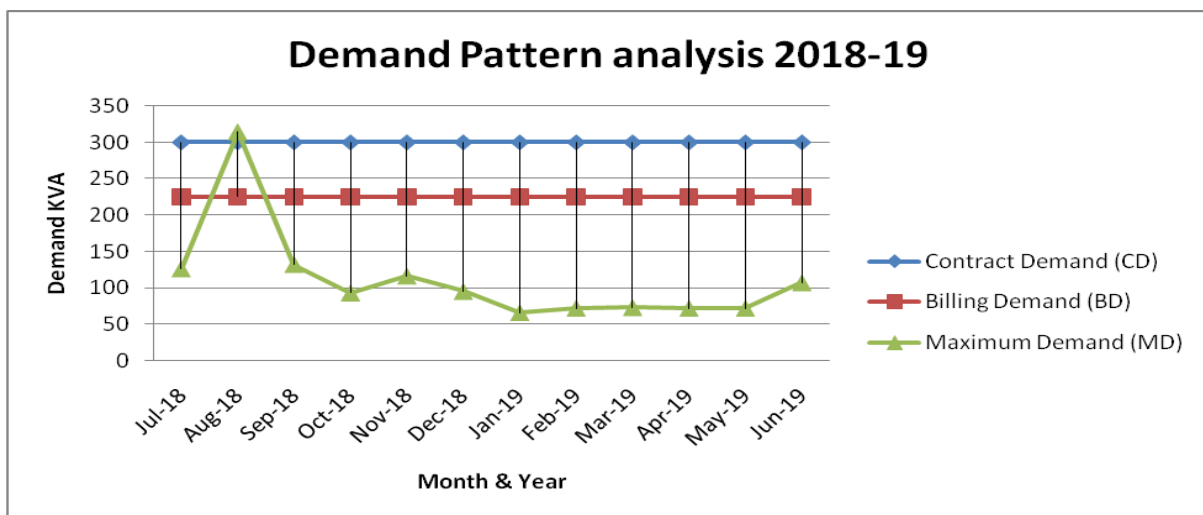


Figure 3.5:- Graphical presentation of demand consumption year 2018-19

**Observation:** It was observed that the contract demand of the university is 300 kVA. There is a variation in maximum demand. It is a maximum of 314 kVA and a minimum of 66 kVA



### 3.6 Monthly Power factor analysis Year-2018-19 (Residency Feeder )

The monthly power factor is given in the following table.

Table 3.6 Power factor for the year 2018-19

Sr. No.	Month & Year	Power Factor (PF)	PF Incentive %	PF Surcharge (Rs/-)
1	Jul-18	0.861	0	17,003
2	Aug-18	0.867	0	10,350
3	Sep-18	0.872	0	10,238
4	Oct-18	0.883	0	2,931
5	Nov-18	0.811	0	10,664
6	Dec-18	0.953	280	0
7	Jan-19	0.991	961	0
8	Feb-19	0.897	0	1,487
9	Mar-19	0.887	0	1,192
10	Apr-19	0.865	0	1,104
11	May-19	0.869	0	1,217
12	Jun-19	0.981	4,473	0
	<b>Total</b>	<b>0.895</b>	<b>5,714</b>	<b>56,186</b>


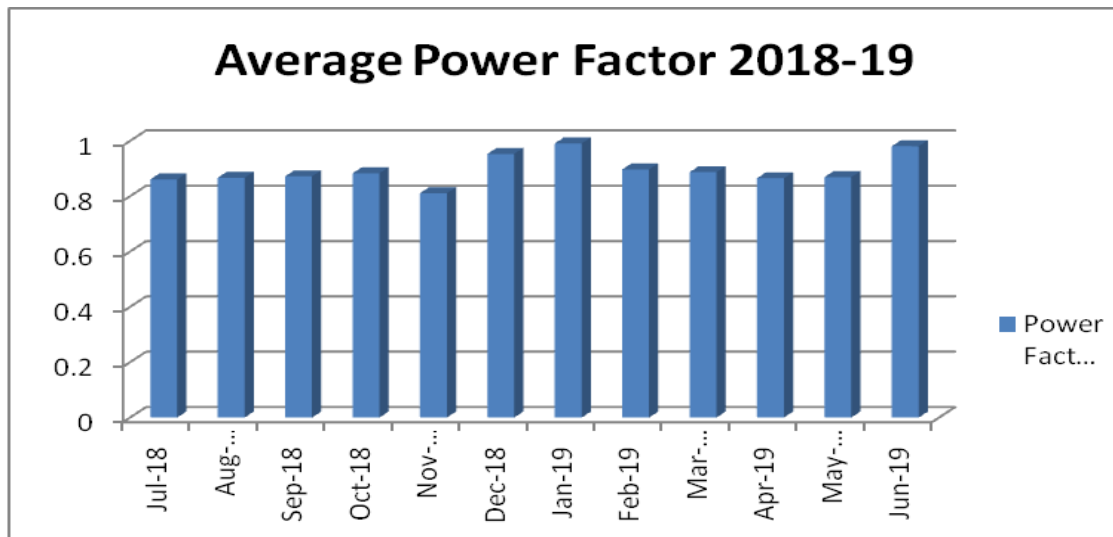


Figure 3.6 Graphical presentation of average power factor year 2018-19

#### Observation:

The average power factor for the year 2018-19 was 0.895.




### 3.7 Some Photographs of electrical equipment's




CFL (PL type)



Efficient light (LED Downlighter)

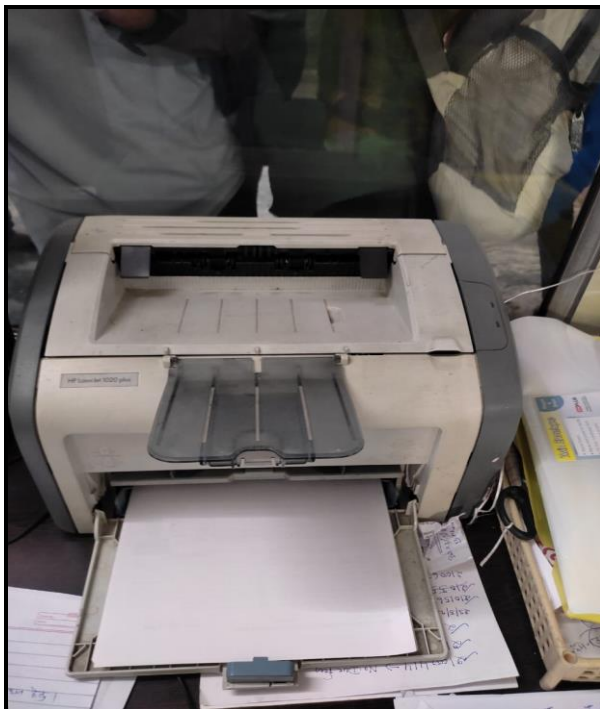

Printer

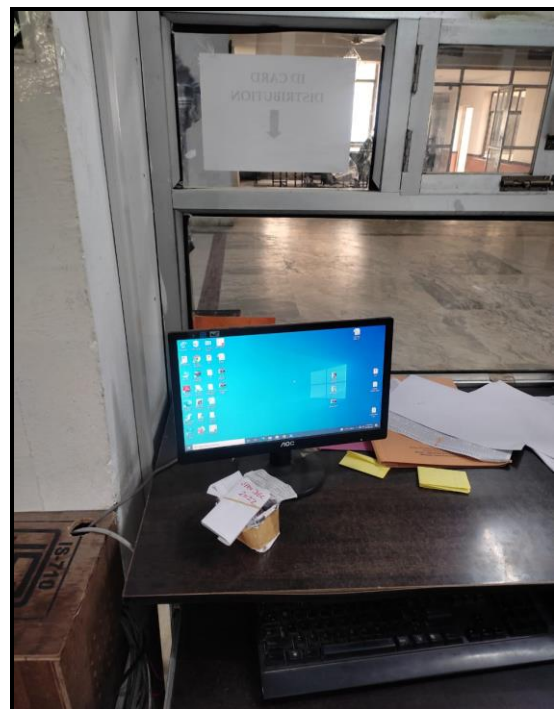

Computer System

Figure 3.7 :- Electrical Equipment in Mewar university



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2018-19**



**END OF THE REPORT**

**THANKS**