

## **ENERGY AUDIT REPORT**



### **MEWAR UNIVERSITY**

**Gangrar Chittorgarh (Rajasthan )**

PREPARED BY

**EMPIRICAL EXERGY PRIVATE LIMITED**

Flat No. 201, OM Apartment, 214 Indrapuri Colony,  
Bhawarkuan, Indore – 452 001 (M. P.), India

0731-4948831, 7869327256

Email ID: [eempirical18@gmail.com](mailto:eempirical18@gmail.com)

[www.eeplgroups.com](http://www.eeplgroups.com)

**(2020-21)**



**Energy Audit Report**  
**Mewar University, Gangrar Chittorgarh**  
**(Rajasthan ) Year 2020-21**



## CONTENT

Sr. No	Item	Page No.
<b>I</b>	<b>Acknowledgement</b>	3
<b>II</b>	<b>Certification Of Accreditation</b>	4
<b>III</b>	<b>Green Monitoring Committee</b>	5
<b>IV</b>	<b>The Audit Team</b>	6
<b>V</b>	<b>Executive Summary</b>	7
<b>Chapter-1</b>	<b>Introduction</b>	10
1.1	About University	10
1.2	About University Campus	13
1.3	Mewar University Layout Of Various Buildings	16
1.4	About Energy Audit	17
1.5	Objectives Of Energy Auditing	17
1.6	Methodology:	18
1.7	Mewar University Present Energy Scenario:	19
<b>Chapter- 2</b>	<b>Power Supply System</b>	20
2.1	Power Station & Transformer:	20
2.2	DG Sets	21
2.3	Capacitor Bank	22
2.4	Grid Connected Solar Photovoltaic System (480 KWp)	23
<b>Chapter- 3</b>	<b>Electricity Bill Analysis</b>	26
3.1	Monthly Electrical Energy Consumption (2020-21) University Feeder	26
3.2	Monthly Demand Analysis (2020-21) University Feeder	27
3.3	Monthly Power Factor Analysis: Year (2020-21) University Feeder	28
3.4	Monthly Electrical Energy Consumption (2020-21) Residency Feeder	29
3.5	Monthly Demand Analysis (2020-21) Residency Feeder	30
3.6	Monthly Power Factor Analysis: Year (2020-21) Residency Feeder	31
3.7	Connected Load Of University	32
3.8	Some Photograph Of Equipment's	33
<b>Chapter- 4</b>	<b>Energy Conservation And Recommendation</b>	35



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2020-21**



## **ACKNOWLEDGEMENT**

**Empirical Exergy Private Limited (EEPL), Indore (M.P)** takes this opportunity to appreciate & thank the management of **Mewar University Gangrar Chittorgarh** for allowing us to conduct an energy audit for the university.

We are indeed touched by the helpful attitude and co-operation of all faculties and technical staff, who rendered their valuable assistance and co-operation during the course of study.

**Rajesh Kumar Singadiya**

**(Director)**

M.Tech (Energy Management), PhD (Research Scholar)

Accredited Energy Auditor [AEA-0284]

Certified Energy Auditor [CEA-7271]

(BEE, Ministry of Power, Govt. of India)

Empanelled Energy Auditor with MPUVN, Bhopal M.P.


Lead Auditor ISO50001:2011 [EnMS) from FICCI, Delhi

Certified Water Auditor (NPC, Govt of India)

Chartered Engineer [M-1699118], The Institution of Engineers (India)

Member of ISHRAE [58150]


## Certification Of Accreditation



**BUREAU OF ENERGY EFFICIENCY**

Examination Registration No.: ..... **EA- 7271** .....

Accreditation Registration No.: ..... **AEA-284** .....



### Certificate of Accreditation

This is to certify that Mr./Ms. **Shri. Rajesh Kumar Singadiya** having its trade/registered office at ..... has been given accreditation as accredited energy auditor. The certificate shall be effective from **9<sup>th</sup>** day of **May, 2018** .....


The certificate is subject to the provisions of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

This certificate shall be valid until it is cancelled under regulation 9 of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

On cancellation, the certificate of accreditation shall be surrendered to the Bureau within fifteen days from the date of receipt of order of cancellation.

Your name has been entered at AEA No. **284** ..... in the register of list of accredited energy auditors. Your name shall be liable to be struck out on the grounds specified in regulation 8 of the Bureau of Energy Efficiency (Qualifications for Accredited Energy Auditors and Maintenance of their List) Regulations, 2010.

Given under the seal of the Bureau of Energy Efficiency, Ministry of Power, this **5<sup>th</sup>** day of **October, 2018**

  
Secretary,  
Bureau of Energy Efficiency  
New Delhi

**Green Monitoring Committee.**

**OFFICE OF THE REGISTRAR  
MEWAR UNIVERSITY, CHITTORGARH (RAJ.).**

No. MU/RO/Admin/2022/1450

Dated : 4/5/2022

**OFFICE ORDER**

**Reconstitution of Green, Environment & Energy Auditing Committee**

Green Audit, Environment Audit & Energy Audit Committee is reconstituted to conduct the necessary audit in due course. Members of the Audit Committee are mentioned below:

S. No.	Name	Designation	Committee Role
1	Dr. Y. Sudershan	Professor & Dean, Department of Agriculture	Co-Ordinator
2	Mr. Rakesh Kumar Singadiya	Director, Empirical Exergy Pvt. Ltd.	External Auditor
3	Dr. Neelu Jain	Associate Professor, Department of Agriculture	Internal Auditor
4	Dr. Satish Kumar Ameta	Asst. Professor, Department of Life Science	Internal Auditor
5	Mr. Deepak Kumar Joshi	Asst. Professor, Department of Electrical Engg.	Internal Auditor
6	Dr. Mohd. Ashid	Asst. Professor, Department of Chemistry	Member
7	Ms. Nirma Kumari Sharma	Asst. Professor, Department of Electrical Engg.	Member
8	Mr. Suraj Kumhar	Asst. Professor, Department of Electrical Engg.	Member
9	Mr. H. Widhani	OSD	Member
10	Mr. Narendra Kumar Ved	Non-Teaching Staff	Member
11	Ms. Sanchita Karnik	Non-Teaching Staff	Member

  
 Registrar  
 Mewar University  
 Gangrar, (Chittorgarh)

**Copy to:**

1. PS to Hon'ble Chairperson for Kind information.
2. PS to President/Pro President for kind information.
3. Deans/Directors/CoE for Information.
4. All HoDs for information.
5. Concerned Committee Members
6. Coordinator, IQAC Cell.
7. Admission/Accounts/Examination/Stores/IT Support/Library/
8. Wardens/Maint.I-C/Receptionist



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2020-21**



**The Audit Team**

The study team constituted of the following senior technical executives from **Empirical Exergy Private Limited,**

- ✚ **Mr. Rajesh Kumar Singadiya** [ Director & Accredited Energy Auditor AEA-0284]
- ✚ **Mr. Rakesh Pathak,** [Director & Electrical Expert]
- ✚ **Dr. Suresh Kumar Soni** [Certified Energy Auditor & Energy Expert]
- ✚ **Mr. Sachin Kumawat** [ Sr. Project Engineer]
- ✚ **Mr. Aakash Kumawat** [Site Engineer]
- ✚ **Mr. Ajay Nahra,** [Sr. Accountant & admin ]

## EXECUTIVE SUMMARY

The executive summary of the energy audit report furnished in this section briefly gives the identified energy conservation measures and other recommendations during the project that can be implemented in a phased manner to conserve energy and increase productivity inside the university campus.

### **ENERGY MANAGEMENT INITIATIVE TAKEN BY UNIVERSITY**

#### **✚ 480 KWp SOLAR PHOTOVOLTAIC ROOFTOP INSTALLATION:**

University has a 480 KWp solar photovoltaic rooftop grid-connected system installed on most of the buildings. The solar unit generated for the year 2020-21 is 6,32,850 units. It is more than 50 % of the total unit consumption of the university campus.

#### **RECOMMENDATION:-**

#### **✚ POWER FACTOR IMPROVEMENT ON UNIVERSITY FEEDER**

The average power factor for the year 2020-21 was 0.862 on the university feeder. It is recommended to maintain the power factor unity.

#### **✚ LIGHTING SYSTEM**

University has already initiated the installation of energy-efficient lighting in new construction buildings and the replacement of “conventional tube light by an energy-efficient LED tube light and LED downlighter. **It's Appreciable.**

#### **✚ TIMER-CONTROLLED STREET LIGHTS**

There are 3 high masts on the university campus. The high mast operated with the timer control system. **It's Appreciable.**

#### **✚ CEILING FAN AND EXHAUST FAN:**

University is going to replace “conventional ceiling fan (60 Watt )” with an energy-efficient star-rated fan or BLDC-based energy-efficient fan (28 Watt) in classrooms, laboratories, and faculties cabin in phased manner and has great potential for energy saving.

University is going to replace the “conventional exhaust fan (180 Watt)” with an energy-efficient star-rated fan or BLDC-based energy-efficient Fan (40 Watt) in the university's main building classrooms, laboratories, and faculties cabin has great energy-saving potential.



**Energy Audit Report**  
**Mewar University, Gangrar Chittorgarh**  
**(Rajasthan ) Year 2020-21**



## **ENERGY CONSERVATION MEASURES FOR ELECTRICAL SYSTEM**

<b>Case Study</b>	<b>Section</b>	<b>Identification</b>	<b>Observation</b>	<b>Recommendation</b>	<b>Annual energy saving (kWh)</b>	<b>Annual cost saving (Rs.)</b>	<b>Investment (Rs.)</b>	<b>Simple payback Period (Year )</b>
1	Lighting System	160 No. FTL tubelight	Power consumption by T-12 (36 Watt)	Replacement of conventional (36Watt) tubelight with (20 Watt) LED	4096	30,351	33,600	1.1
2	Lighting System	1294 No. FTL tubelight	Power consumption by T-12 (28 Watt)	Replacement of conventional (28Watt) tubelight with (20 Watt) LED	16,563	1,22,733	2,71,740	2.2
3	Celling Fan	2600 No ceiling fan working with 60 Watt	Power consumption by exesting ceiling fan (60 Watt)	Replacement of 60W conventional ceiling fan by 28W BLDC energy efficient ceiling fan	1,66,400	9,86,419	54,60,000	5.5.





**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2020-21**



**CHAPTER-1  
INTRODUCTION**

**1.1 About University**

Mewar University is an autonomous body set up by the Government of Rajasthan through Act. No. 4 of 2009 passed by the Rajasthan Legislative Assembly (Government of Rajasthan). The University is recognized by the UGC u/s 2(f) of UGC Act with powers to confer degrees u/s 22(1) of the UGC Act, 1956 vide their letter no. F.9-15/2009(CPP-I) dated 30<sup>th</sup> March 2009. This is the only private and self-financed University in Rajasthan which is also approved by the UGC u/s 12B of the UGC Act vide their letter No. F.9-15/2009 (CPP-I/PU) dated 15<sup>th</sup> October 2018. The University is also NAAC accredited.

Mewar University has never affiliated any institution, nor has the University ever set up any study center in any part of the country other than its main campus at Gangrar in Chittorgarh (Rajasthan).

Mewar University is promoted by the Mewar Education Society (MES). It is controlled by a Board of Management, constituted by the MES, which is headed by Chairperson Shri Ashok Kumar Gadiya, a great visionary, educationist, and nationalist, who translated his ideas and dreams of promoting higher education into reality by setting up institutes of learning in various subjects. In no time, he has carved out a niche for himself as an educationist, who believes in the inculcation of values through education in the young generation.

The group, under the able leadership of Dr. Ashok Kumar Gadiya and the active support and association of renowned academicians, experienced professionals, and technocrats, has established a chain of Institutes of higher education and learning:

**✚ Mewar Institute of Management**

Mewar Institute of Management, Vasundhara, Ghaziabad (U.P.) [Approved by the UGC and affiliated with C.C.S. University, Meerut, conducting courses for B.B.A., M.B.A., B.C.A., M.C.S., M.I.S., B.Ed, B.Lib, and M.Sc. (Biotech)]

**✚ Mewar Law Institute**

Mewar Law Institute, Vasundhara, Ghaziabad (U.P.) [Approved by the UGC, Bar Council of India and affiliated to C.C.S. University, Meerut, conducting courses for L.L.B. (3Yrs) & L.L.B. (5Yrs)]



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2020-21**



**+ Mewar Girls Business School**

MewarGirls Business School, Vasundhara, Ghaziabad (U.P.) [Approved by the AICTE and affiliated to UP Tech University, Lucknow, conducting M.B.A. courses for Girls]

**+ Mewar Girls College**

MewarGirls College, Chittorgarh [Approved by Government of Rajasthan and affiliated to Mohan Lal Sukhadia University, Udaipur, conducting courses for M.I.B., B.Sc (Biotech.), B.B.M., B.C.A. & P.G.D.C.A.]

**+ Mewar Girls Ayurved Nursing Centre**

Mewar Girls Ayurved Nursing Centre, Chittorgarh [Approved by Government of Rajasthan and affiliated to Rajasthan Ayurved University, Jodhpur, conducting courses for Ayurved Nursing]

**+ Mewar Girls Industrial Training Centre**

Mewar Girls Industrial Training Centre, Chittorgarh [Approved by Government of India (NCVT) and Board of Technical Education, Jodhpur, (SCVT), conducting courses for Computer Operator and Programming Assistant, Interior Decoration, Fashion Designing, Dress Making, English Language Proficiency and Personality Development]

**+ Mewar Girls College of Teachers Training**

Mewar Girls College of Teachers Training, Chittorgarh [Approved by Government of India (NCTE) and affiliated to Mohan Lal Sukhadia University, Udaipur, conducting courses for B.Ed., N.T.T, S.T.C]

These centers of learning exemplify the group's mission to promote quality technical and higher education. And as a result, the number of students has gone up considerably, and now it has more than 10,000 students on its campuses.

The group, continuing with its mission to provide higher and technical education to a larger section of people, has touched a new height by promoting and sponsoring Mewar University. The promoting body, with its honest efforts and unstinting dedication, has the conviction to build a strong partnership with the Government of Rajasthan for ensuring the spread of higher and technical education in the state.

Mewar's culture, ethos, tradition, and values are so ingrained in its soil that it is bestowed with the magical powers to sprout prodigious talent and genius. Anyone groomed in this environment will undergo a steady transformation to blossom in life and imbibe the traits of greatness associated with this historical place.



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2020-21**



**VISION:-**

To develop a center of excellence for technical, professional, and vocational education and research at par with national and international standards.

**MISSION:-**

To develop the framework for effectively conducting various educational and research programmes of the highest standards to produce confident, self-reliant, and responsible youth for society and outstanding professionals for government, industry, and business. The mission is to "**Reach the unreached**"

**OBJECTIVE:-**

- ❖ Provide easy access to high-quality education in Management, Engineering, as well as other academic & professional fields to its students, irrespective of their caste, creed, age, gender, region, or country, at an affordable cost.
- ❖ To offer a conducive environment for pursuing research and vocational studies with a market-driven orientation.
- ❖ To expose students to new ideas, fresh vision, and pragmatic ambition and enhance their competency in the ever-changing business environment.
- ❖ To provide a flexible choice-based credit system of education and dual-degree programmes while flexible adopting modes of delivery to suit students' requirements of learning.
- ❖ To prepare and assist students in improving their prospects through career counseling and placement support, on-the-job training, industrial visits, presentations, and group discussions.
- ❖ To Promote and practice a convenient distance education concept in India and abroad.
- ❖ To spread job-oriented Skill Development education in rural and tribal areas



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2020-21**



**1.2 About Campus: -**

Table 1.1 Details are the total build-up area given in the table:-

<b>TOTAL GROUND COVERED. =20856.78 SQ.MT</b>									
<b>TOTAL OVERALL BUILT-UP ALL FLOORS AREA:- 76024.72 SQ.MT</b>									
S.NO	BLOCK	FAR AREA				BUILT AREA			
		GROUND FLOOR AREA IN SQ.MT	FIRST FLOOR AREA IN SQ.MT	SECOND FLOOR AREA IN SQ.MT	THIRD FLOOR AREA IN SQ.MT	GROUND FLOOR AREA IN SQ.MT	FIRST FLOOR SQ.MT	SECOND FLOOR AREA IN SQ.MT	THIRD FLOOR AREA IN SQ.MT
1	ADMINISTRATIVE AND ACADEMIC BLOCK	8890.84	8519.33	8675.24	8675.24	8966.05	9050.97	9206.74	9206.74
2	EDUCATION BLOCK	1062.08	1170.08	1062.08	1062.1	1193.08	1253.27	1126.29	1126.29
3	ENGINEERING BLOCK	1979.9	11979.9	1979.9	0	2126.84	2093.74	2093.74	0
4	MEWAR HOSPITAL	1337.03	1337.03	0	0	1590.91	1590.91	0	0
5	BHAMASHAH HOSTEL	1382.11	1382.11	1382.11	1382.1	1601.64	1572.82	1572.82	1572.82
6	SANGA HOSTEL	1189.78	1189.78	1189.78	1189.8	1359.6	1341.62	1341.62	1341.62
7	KUMBHA HOSTEL	602.71	602.71	620.65	620.65	709.19	697.35	697.35	697.35
8	PRATAP HOSTEL	640.52	640.52	665.78	665.78	749.38	739.64	739.64	739.64



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2020-21**



S.NO	BLOCK	FAR AREA				BUILT AREA			
		GROUND FLOOR AREA IN SQ.MT	FIRST FLOOR AREA IN SQ.MT	SECOND FLOOR AREA IN SQ.MT	THIRD FLOOR AREA IN SQ.MT	GROUND FLOOR AREA IN SQ.MT	FIRST FLOOR SQ.MT	SECOND FLOOR AREA IN SQ.MT	THIRD FLOOR AREA IN SQ.MT
9	PANNA DHAI HOSTEL	376.53	376.53	382.3	382.3	447.6	435.97	435.97	435.97
10	MEERA HOSTEL	323.13	323.13	323.13	323.13	386.87	381.68	381.68	381.68
11	GUEST HOUSE	229.94	223.58	223.58	223.58	295.78	258.82	258.82	258.82
12	STAFF QUARTERS(1 BHK)	285.11	285.11	285.11	285.11	367.6	362.67	362.67	362.67
13	STAFF QUARTER	276.99	276.99	276.99	276.99	353.84	349.18	349.18	349.18
14	ANNAPURNA MESS	613.7	0	0	0	708.4	0	0	0
	TOTAL	19190.37	28306.8	17066.65	15086.78	20856.78	20128.64	18566.52	16472.78

Satellite Image of Mewar university from Google map


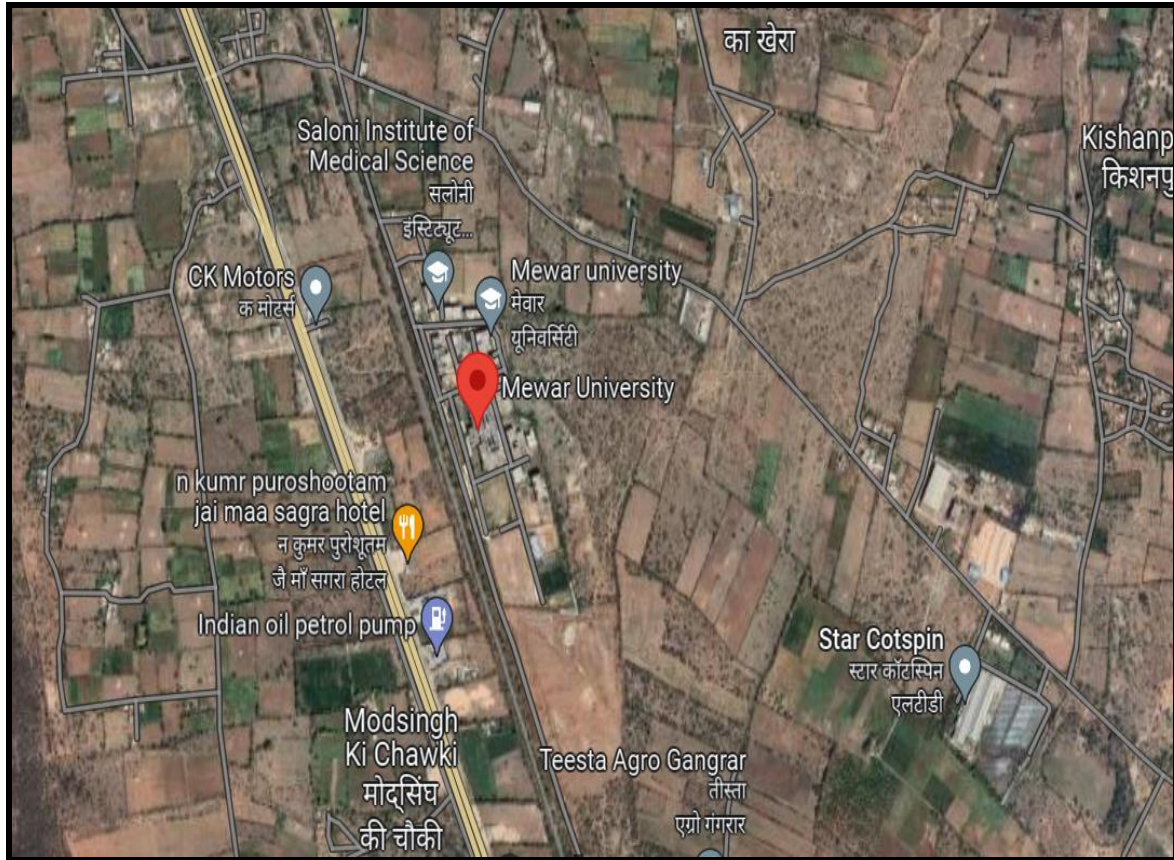


Figure 1.1: - Satellite Image of Mewar university from Google map

### 1.3 MEWAR UNIVERSITY LAYOUT OF VARIOUS BUILDINGS

Layout map of Mewar University



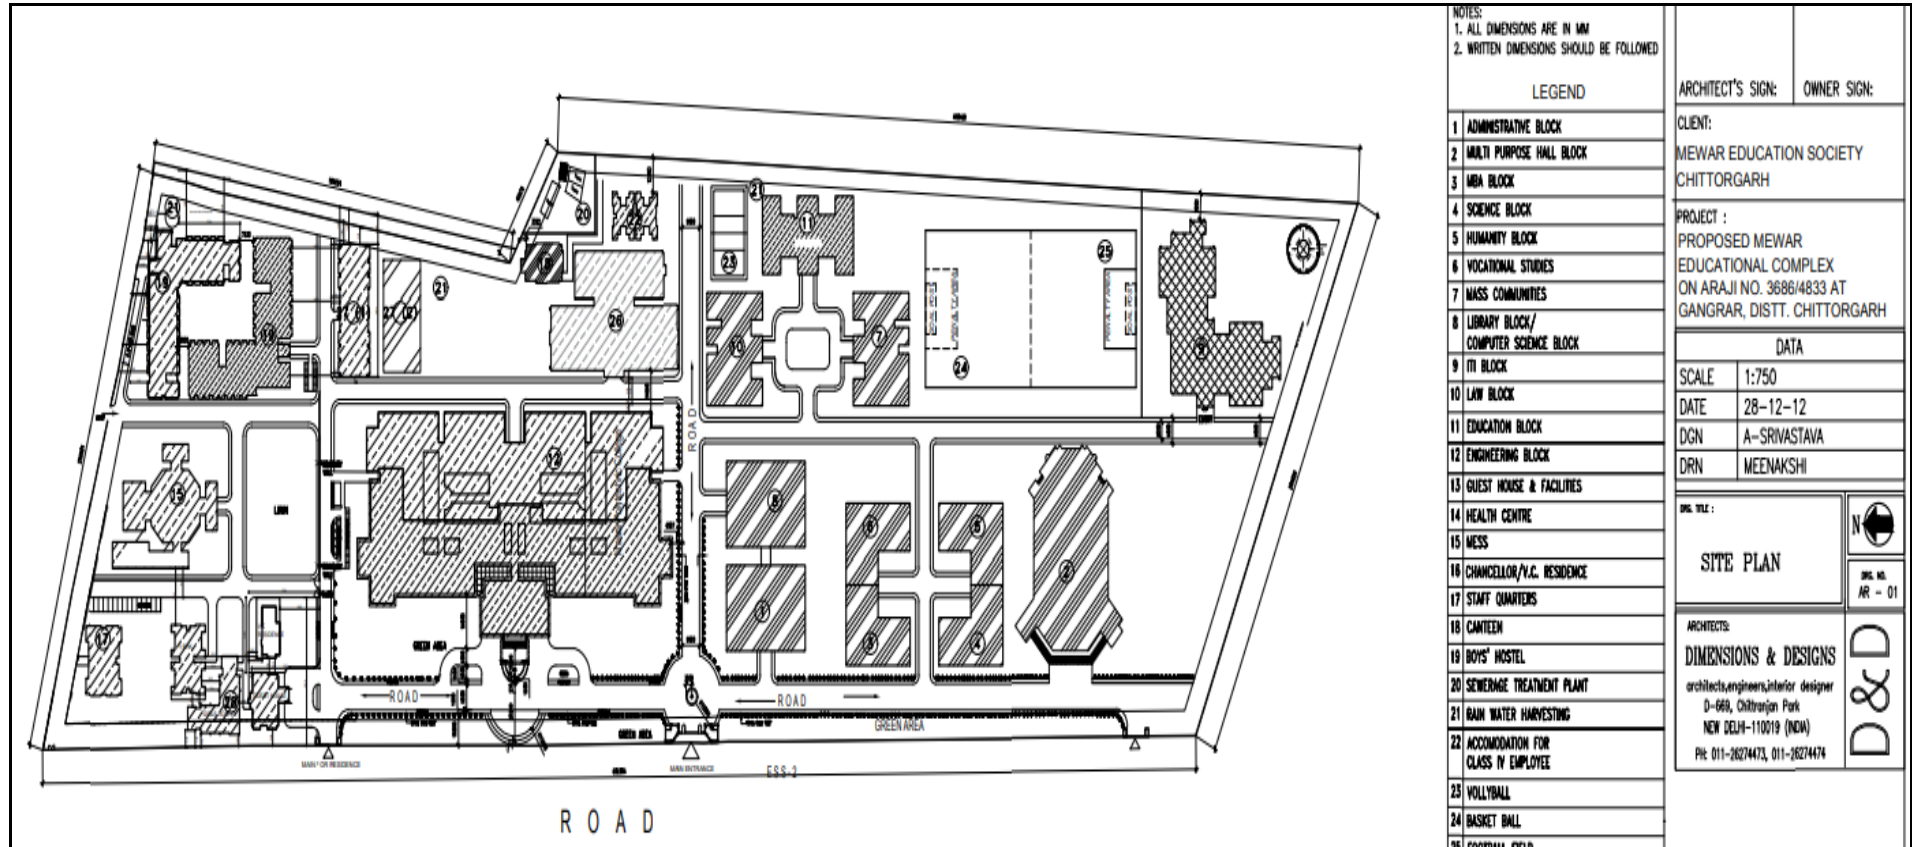

## Energy Audit Report Mewar University, Gangrar Chittorgarh (Rajasthan ) Year 2020-21



### 1.4 About Energy Audit

An energy audit helps to understand more about the ways energy is used in any plant and helps in identifying areas where waste may occur and scope for improvement exists. The overall energy efficiency from generation to the final consumer becomes 50%. Hence one unit saved in the end user is equivalent to two units generated in the power plant.

An energy audit is the most efficient way to identify the strength and weaknesses of energy management practices and to find a way to solve problems. An energy audit is a professional approach to utilizing economic, financial, social, and natural resources responsibly. Energy audits “adds value” to management control and are a way of evaluating the system.

**Empirical Exergy Private Limited (EEPL)**, Indore M.P. carried out the “Energy Audit” at the site to find gaps in the energy consumption pattern for **Mewar University, Chittorgarh**. A technical report is prepared as per the need and the requirement of the project.

### 1.5 Objectives of Energy Auditing

An energy audit provides a vital information base for an overall energy conservation program covering essentially energy utilization analysis and evaluation of energy conservation measures. It aims at:

- Identifying the quality and cost of various energy inputs.
- Assessing the present pattern of energy consumption in different cost centers of operations.
- Relating energy inputs and production output.
- Identifying potential areas of the thermal and electrical energy economy.
- Highlighting wastage in major areas.
- Fixing of energy-saving potential targets for individual cost centers.
- Implementation of measures for energy conservation & realization of savings.



### **1.6 Methodology:**

The methodology adopted for achieving the desired objectives viz.: Assessment of the current operational status and energy savings includes the following:

- ✚ Discussions with the concerned officials for identification of major areas of focus and other related systems.
- ✚ A team of engineers visited the site and had discussions with the concerned officials/supervisors to collect data/information on the operations and load distribution within the plant and the same for the overall premises. The data were analyzed to arrive at a baseline energy consumption pattern.
- ✚ Measurements and monitoring with the help of appropriate instruments including continuous and/or time-lapse recording, as appropriate and visual observations were made to identify the energy usage pattern and losses in the system.
- ✚ Trend analysis of costs and consumptions.
- ✚ Capacity and efficiency test of major utility equipments, wherever applicable.
- ✚ Estimation of various losses
- ✚ Computation and **in-depth analysis** of the collected data, including utilization of computerized analysis and other techniques as appropriate, were done to draw inferences and to evolve suitable energy conservation plan/s for improvements/reduction in specific energy consumption.



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2020-21**



**1.7 Mewar University present energy scenario.**

Mewar university uses energy in the form of electricity purchased from the grid and a 480 KWp solar grid-connected system for the university campus. There are two feeders one is for education building and the other for residency

The annual energy consumption of **Mewar University** campus is about **12,26,968** units (Grid + Solar ) period from July-2020 to June-2021

Mewar University has a 480 KWp solar photovoltaic rooftop grid-connected system installed on almost all buildings. Total Solar generation from July-2020 to June-2021 is **12,26,968** units. Annual Solar unit generation for the year 2020-21 is 6,29,936 units.

## CHAPTER- 2 POWER SUPPLY SYSTEM

### 2.1 Transformer and substation

The power supply for the Mewar university is from AVVNL with the help of 11 kV feeders. There are 3 electricity connections. One is a university feeder under Tariff 2620G 11 KV Non-Industrial with sanctioned load of 425 kW. The second is a residency feeder under tariff 1011, 11 KV Non-Industrial with sanctioned load of 400 kW, and the third are bank feeder with 14 kW. There are two step-down transformers having capacities are 630 KVA and 500 KVA. university and residential respectively. The details are given in following table 2.1

Table: 2.1 Nameplate details of transformers -01 and 02

Sr. No.	Items	Technical Specification of Transformer -01 (University Feeder)	Technical Specification of Transformer -02 (Residency Feeder)
1	Make	Ganga Sagar Agro Pipes Private Limited	Uttam (Bharat) Electrical Private Limited
2	Year	2008	2012
3	Rating (kVA)	630	500
4	Voltage (HV/ LV)	11000/433	11000/433
5	Current Rating (HV/ LV)	33.10 / 838	26.24/666.71
6	Frequency (Hz)	50	50
7	Impedance at 75°C (%)	4 %	4 %
8	Vector group	Dyn-11	Dyn-11
9	Type of cooling	ONAN	ONAN
10	Total no of Tap	5	5



Figure 2.1:- 11 kV Feeder and 630 kVA and 500 kVA

## 2.2 DG Set:-

There are 2 DG sets on the university campus. Details of the DG Sets are given table. 2.4

Table 2.4 Technical specifications for DG sets- 01 and 02

Sr. No.	Parameter	Technical Specification DG Set-01 (University Feeder)	Technical Specification DG Set-02 (Residency Feeder )
1	Make	Stamford	Stamford
2	M/C No	N136288779	N02609855
3	Capacity (KVA)	250	200
4	Rated Voltage	415	415
5	Full load current	347.8	278
6	Frequency	50	50
7	Power factor	0.8	0.8
8	RPM	1500	1500
9	Phase	3	3



Figure 2.4:- DG set in Power House

### Observation & Suggestion:

- DG set is used only in case of grid power failure.
- There is no system to monitor fuel consumption w.r.t. unit generation.

### 2.3 Capacitor Bank

The energy audit team examine of existing capacitor bank at the powerhouse. Details of the capacitor are given in table 2.5

Table: 2.5 Details of Capacitor bank

Sr. no	Capacitor no	Capacity	Location	Remark
1	Capacitor -01	5 kVAr	Main University Panel	Working
2	Capacitor -02	5 kVAr	Main University Panel	Working
3	Capacitor -03	5 kVAr	Main Residential Panel	Working
4	Capacitor -04	5 kVAr	Main Residential Panel	Working



Figure 2.5 Capacitor bank on main panel

**Observation:-** Energy audit team examined individual capacitors at the site. It was found that all the capacitors are in working condition.

#### 2.4 Grid Connected Solar Photovoltaic System (480 Kw)

There is a 480KWp solar photovoltaic rooftop grid-connected system installed on various buildings. System details are given below:

Table: - 2.6 Solar plant detailed

Sr. No	Description	Technical Specification
1	Plant Information	
1.1	Plant capacity	480 kWp
1.2	Locations	1. Administrative and Academic building 2. Kumbha Hostel building. 3. Pratap Hostel building. 4. Sanga Hostel building. 5. Mewar Hospital 6. Panna Dhai Girls Hostel . 7. Meera Girls Hostel.
1.3	Latitude & Longitude	23.3103 N & 77.3619 E
2	PV Panel Details	
2.1	Make	M/s. Goldi Green Technologies Pvt. Ltd
2.2	Panel Type	Poly-crystalline
2.3	Panel Wattage	320 Wp
2.4	No of PV Panels	1478
2.5	Total Capacity	480 kWp
3	Inverter Information	
3.1	Make	KSTAR
3.2	Model	1. KSG-50K = 04 2. KSG-20K = 06 3. KSG-15K = 01 4. KSG-20K =05
3.3	Capacity	480 Kw

Sr. No	Building Name	Total No of Inverter	Inverter Modal	No of Penal
1	Administrative and Academic building	2	KSG-20 K	730
		4	KSG-50 K	
2	Kumbha Hostel	2	KSG-20 K	110
3	Pratap Hostel	1	KSG-15 K	108
		1	KSG-20 K	
4	Sanga Hostel	2	KSG-30 K	190
5	Mewar Hospital	2	KSG-30 K	190
6	Panna Dhai Hostel	1	KSG-20 K	60
7	Meera Girls Hostel	1	KSG-30 K	90

**Photographs of Solar Plant:-**



Figure 2.6:- Solar Plant 480 KWp and Inverter System



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2020-21**



**Total Solar unit generation:-**

Table 2.7:- Total Solar Unit generation Year-2020-21

<b>Sr. No</b>	<b>Year</b>	<b>Unit</b>
1	2020-21	6,29,936
	<b>Total</b>	<b>6,29,936</b>



**CHAPTER- 3**  
**ELECTRICITY BILL ANALYSIS**

**3.1 Monthly electrical energy consumption 2020-21:- (University Feeder )**

The monthly electrical consumption for the university is given in the table.

Table 3.1 Energy consumption and billing amount (the year 2020-21)

Sr. No.	Month & Year	Total Unit Consumption (kWh)	Total Amount	Overall Per Unit Charge
1	Jul-20	23,810	2,53,100	10.63
2	Aug-20	28,736	1,54,445	5.37
3	Sep-20	26,543	1,62,818	6.13
4	Oct-20	22,860	1,16,160	5.08
5	Nov-20	27,105	3,11,990	11.51
6	Dec-20	12,888	1,03,134	8.00
7	Jan-21	43,176	3,18,993	7.39
8	Feb-21	10,896	61,725	5.66
9	Mar-21	32,824	1,77,341	5.40
10	Apr-21	32,388	3,42,190	10.57
11	May-21	30,271	3,14,720	10.40
12	Jun-21	20,388	57,287	2.81
	<b>Total</b>	<b>3,11,885</b>	<b>23,73,903</b>	<b>7.41</b>

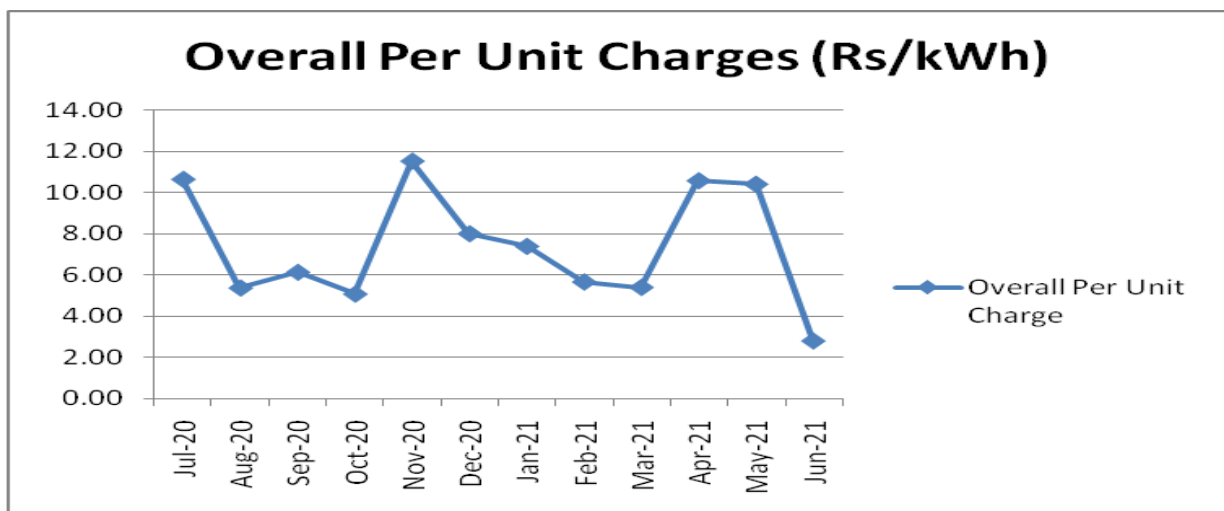


Figure 3.1:- Graphical presentation of actual per-unit charges for the year 2020-21

**Observation:**

It was found that total energy consumption in the last 12 months was 311,885 units. The average annual energy charge is Rs 7.41 /kWh.

### 3.2 Monthly demand analysis (2020-21) at University feeder.

The monthly demand consumption for the university is given in the table.

Table 3.2:- Monthly demand analysis (KVA) consumption pattern year 2020-21

Sr. No.	Month & Year	Contract Demand (CD)	Billing Demand (BD)	Maximum Demand (MD)
1	Jul-20	300	225	47
2	Aug-20	300	225	104
3	Sep-20	300	225	39
4	Oct-20	300	225	86
5	Nov-20	300	225	78.8
6	Dec-20	300	225	98
7	Jan-21	300	225	185
8	Feb-21	300	225	65
9	Mar-21	300	225	144.8
10	Apr-21	300	225	136.4
11	May-21	300	225	129
12	Jun-21	300	225	78.8
	Minimum Demand (KVA)			<b>39</b>
	Maximum Demand (KVA)			<b>185</b>
	Average Demand (KVA)			<b>99.3</b>

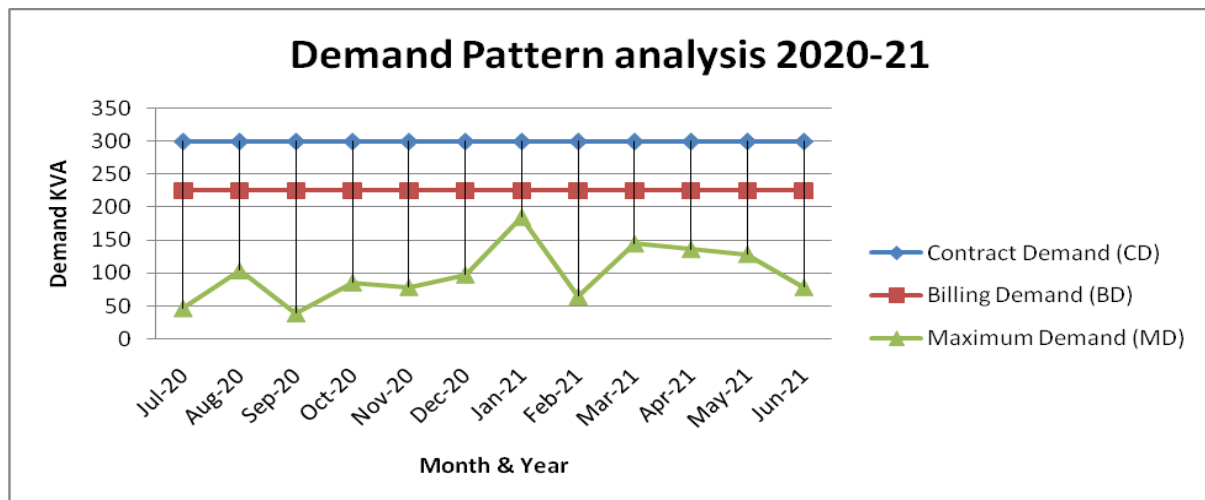


Figure 3.2:- Graphical presentation of demand consumption in the university year 2020-21

**Observation:** It was observed that the contract demand of the university is 300 kVA. There is a large variation in maximum demand. It is a maximum of 185 kVA and minimum of 39 kVA

### 3.3 Monthly Power factor analysis Year-2020-21 (University Feeder )

The monthly power factor for the university is given in the following table.

Table 3.3:- Power factor of the university year 2020-21

Sr. No.	Month & Year	Power Factor (PF)	PF Incentive (Rs/-)	PF Surcharge (Rs/-)
1	Jul-20	0.932	0	0
2	Aug-20	0.986	5,927	0
3	Sep-20	0.933	5,376	0
4	Oct-20	0.965	4,520	0
5	Nov-20	0.981	3,302	0
6	Dec-20	0.982	3,993	0
7	Jan-21	0.985	8,569	
8	Feb-21	0.839	0	5,935
9	Mar-21	0.984	6,251	0
10	Apr-21	0.988	7,196	0
11	May-21	0.921	0	0
12	Jun-21	0.984	3,879	0
	<b>Total</b>	<b>0.957</b>	<b>49,013</b>	<b>5,935</b>

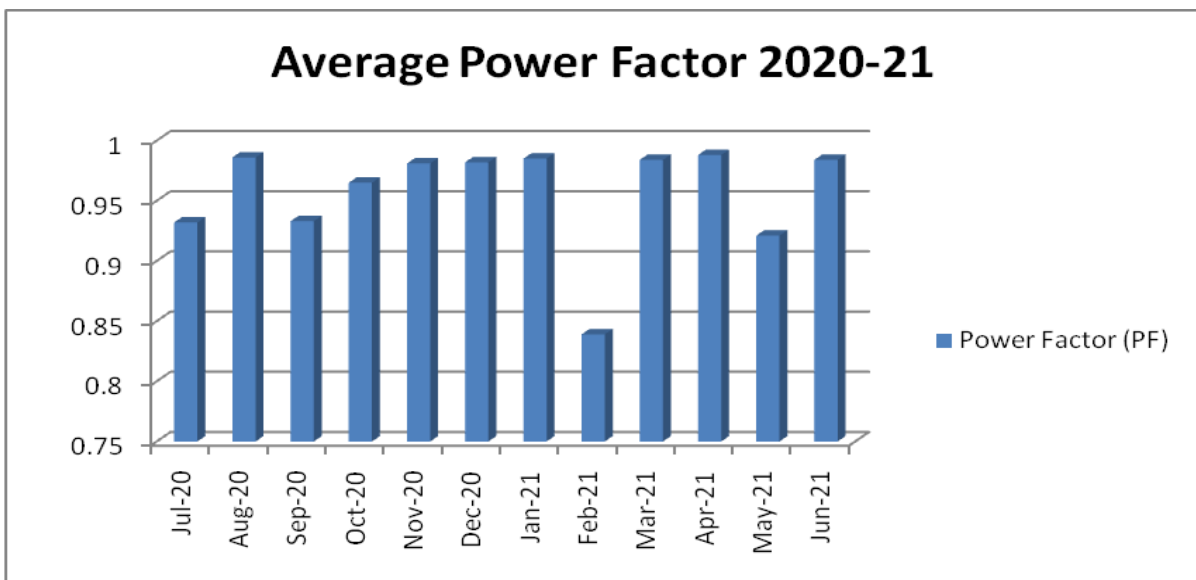


Figure 3.3 Graphical presentation of average power factor year 2020-21

#### Observation:

The average power factor was 0.957 for the year 2020-21. It is recommended to maintain power factor unity.

### 3.4 Monthly electrical energy consumption 2020-21 at (Residency Feeder )

The monthly electrical consumption for the university is given in the table.

Table 3.4 Energy consumption and billing amount year 2020-21

Sr. No.	Month & Year	Total Unit Consumption (kWh)	Total Amount (Rs/-)	Overall Per Unit Charge
1	Jul-20	54,072	6,17,685/-	11.42
2	Aug-20	21,308	2,68,751/-	12.61
3	Sep-20	15,056	1,51,331/-	10.05
4	Oct-20	16,231	1,72,001/-	10.60
5	Nov-20	13,380	99,465/-	7.43
6	Dec-20	12,320	61,982/-	5.03
7	Jan-21	12,160	70,081/-	5.76
8	Feb-21	10,896	61,725/-	5.66
9	Mar-21	9,564	22,938/-	2.40
10	Apr-21	11,012	31,815/-	2.89
11	May-21	10,219	1,12,930/-	11.05
12	Jun-21	98,929	9,90,273/-	10.01
	<b>Total</b>	<b>2,85,147</b>	<b>26,60,977/-</b>	<b>7.91</b>

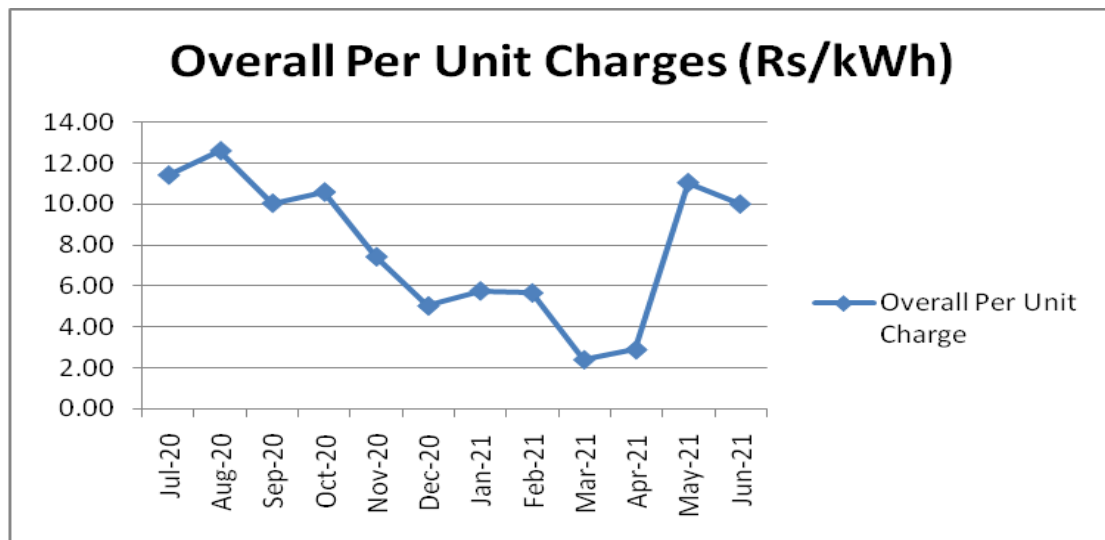


Figure 3.4:- Graphical presentation of actual per-unit charges for years 2020-21

#### Observation:

It was found that total energy consumption in the last 12 months was 2,85,147/- units. The average annual energy charge is Rs 7.91/ kWh.

### 3.5 Monthly Demand analysis (2020-21) on (Residency Feeder )

The monthly demand consumption for the residency feeder is given in the table.

Table 3.5 Monthly demand analysis (KVA) consumption pattern year 2020-21

Sr. No.	Month & Year	Contract Demand (KVA)	Billing Demand (KVA)	Maximum Demand (KVA)
1	Jul-20	300	225	166
2	Aug-20	300	225	152
3	Sep-20	300	225	103
4	Oct-20	300	225	98
5	Nov-20	300	225	92.2
6	Dec-20	300	225	47.5
7	Jan-21	300	225	45.2
8	Feb-21	300	225	65.2
9	Mar-21	300	225	50.4
10	Apr-21	300	225	62.8
11	May-21	300	225	74.5
12	Jun-21	300	225	82.1
	Minimum Demand (KVA)			<b>45.2</b>
	Maximum Demand (KVA)			<b>166</b>
	Average Demand (KVA)			<b>86.6</b>

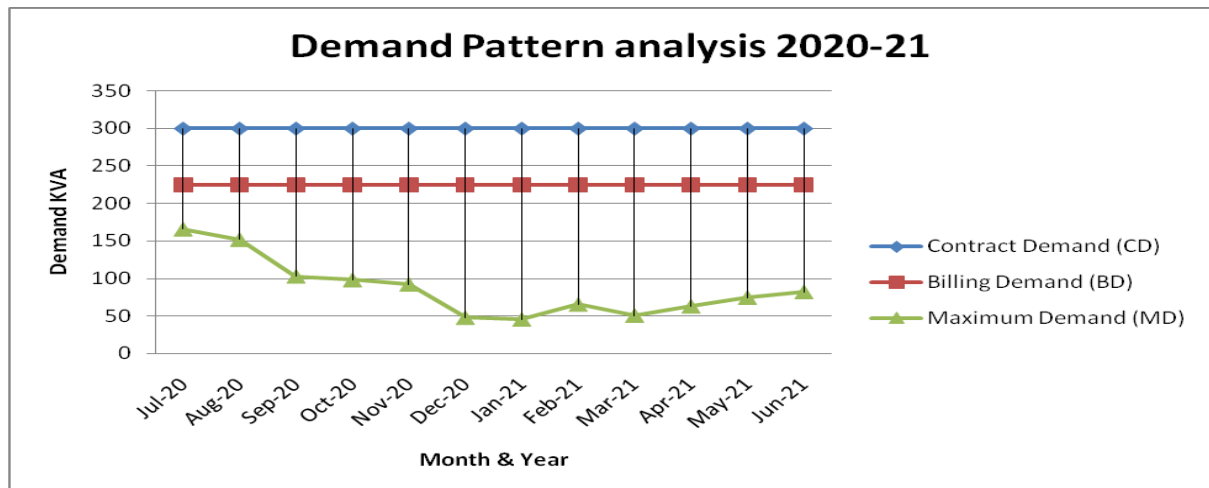


Figure 3.5:- Graphical presentation of demand consumption year 2020-21

#### Observation:

It was observed that the contract demand of the university is 300 kVA. There is a large variation in maximum demand. It is a maximum of 166 kVA and minimum is 45.2 kVA.

**3.6 Monthly Power factor analysis Year-2020-21 (Residency Feeder )**

The monthly power factor is given in the following table.

Table 3.6 Power factor for the year 2020-21

Sr. No.	Month & Year	Power Factor (PF)	PF Incentive (Rs)	PF Surcharge (Rs)
1	Jul-20	0.975	6288	0
2	Aug-20	0.918	0	0
3	Sep-20	0.893	0	941
4	Oct-20	0.932	0	0
5	Nov-20	0.886	0	1,673
6	Dec-20	0.927	0	0
7	Jan-21	0.901	0	0
8	Feb-21	0.839	0	5,935
9	Mar-21	0.841	0	5,037
10	Apr-21	0.863	0	3,638
11	May-21	0.943	0	0
12	Jun-21	0.912	0	0
	<b>Total</b>	<b>0.903</b>	<b>6,288</b>	<b>17,224</b>

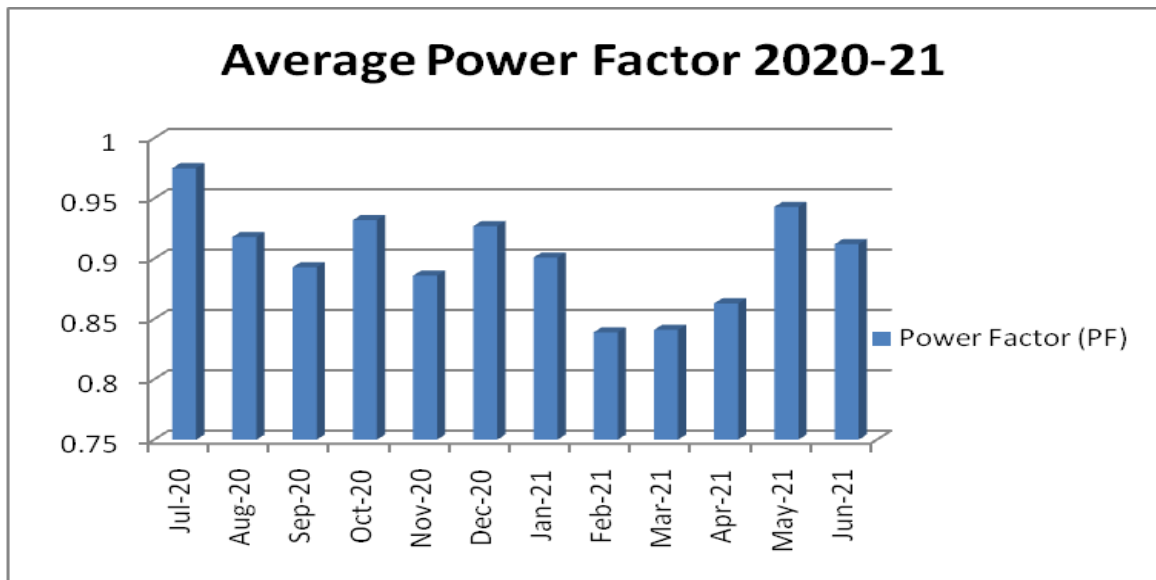


Figure 3.6 Graphical presentation of average power factor year 2020-21

**Observation:**

The average power factor for the year 2020-21 was 0.903. It is recommended to maintain power factor unity.

**Table 3.7:-Total Connected load share % on equipments**

Sr. No.	Equipments	Rated Power (Watt)	Quantity (Nos)	Total Power (kW)	Load Share (%)
1	Tubelight (28 W)	28	1294	36.232	9.7
2	Tubelight (36 W)	36	160	5.76	1.5
3	Celling Fan (60 W)	60	2600	156	41.8
4	LED tubelight (20 W)	20	1244	24.88	6.7
5	CFL (18 W)	18	506	9.108	2.4
6	AC	1500	49	73.5	19.7
7	PC	85	414	35.19	9.4
8	Printer	250	54	13.5	3.6
9	Exhaust	180	68	12.24	3.3
10	Round Light	18	44	0.792	0.2
11	High Mast	1500	4	6	1.6
<b>Total Connected load (KW)</b>				<b>373.202</b>	<b>100.0</b>

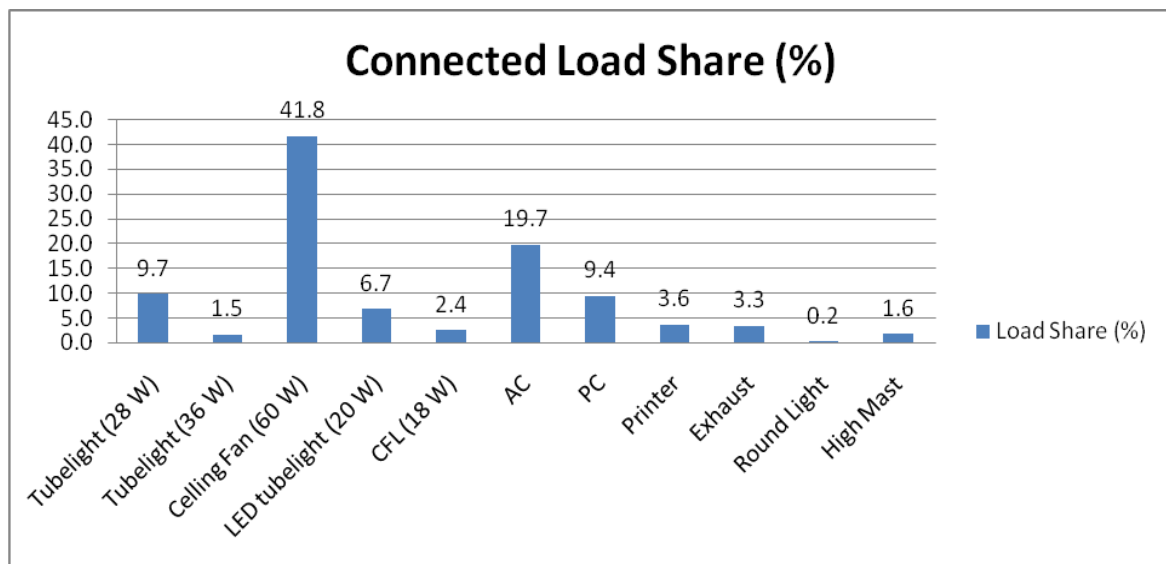


Figure 3.8:- Equipment loading Share % year-2020-21

### 3.8 Some Photographs of Electrical Equipment's



Figure 3.9:- Electrical Equipment in Mewar university



Some Photographs of Energy slogans



CHAPTER- 4  
ENERGY CONSERVATION MEASURES

Case Study No. -01

Replacement of conventional 36 Watt tube light to energy-efficient LED tube light 20 Watt in phase manner:-

Sr. No	Items	Parameters	Units
1	Total Power Consumption by T-12 conventional tube light	36	Watt
2	No of T-8	160	Nos.
3	Working Hrs./Day	8	Hrs./Day
4	Working Days/Year	250	Days/Year
5	Rated Power of Energy Efficient T-5 (LED)	20	W
6	Energy Saving Potential	5,120	kWh/Year
7	Load Factor	0.8	
8	Expected Annual Energy Saving	4,096	kWh/Year
9	Overall, Per Unit Charges	7.41	Rs./kWh
10	Expected Money Saving	30,351	Rs./Year
11	Cost of T-5	200	Rs./ Pices
12	Investment on New Light Purchasing	32,000	Rs.
13	Maintenance Investment@5%	1,600	Rs.
14	Total Investment	33,600	Rs
15	Simple Pay Back Period	13.2	Month

Total Calculated Monetary Saving Potential in lighting = **Rs 30,351 /-**

**Note:-** Energy savings depend on the operation hour per day and the load factor of the systems.

**Case Study No. -02**

**Replacement of conventional 28 Watt tube light to energy-efficient LED tube light 20 Watt in phase manner:-**

Sr. No	Items	Parameters	Units
1	Total Power Consumption by T-12 conventional tube light	28	Watt
2	No of T-8	1,294	Nos.
3	Working Hrs./Day	8	Hrs./Day
4	Working Days/Year	250	Days/Year
5	Rated Power of Energy Efficient T-5 (LED)	20	W
6	Energy Saving Potential	20,704	kWh/Year
7	Load Factor	0.8	
8	Expected Annual Energy Saving	16,563	kWh/Year
9	Overall, Per Unit Charges	7.41	Rs./kWh
10	Expected Money Saving	1,22,733	Rs./Year
11	Cost of T-5	200	Rs./ Pices
12	Investment on New Light Purchasing	2,58,800	Rs.
13	Maintenance Investment @5%	12,940	Rs.
14	Total Investment	2,71,740	Rs
15	Simple Pay Back Period	2.2	Year

**Total Calculated Monetary Saving Potential in lighting = Rs 1,22,733 /-**

**Note:- Energy saving depends on the operation hour per day and the load factor of the systems.**

**Case Study No. 3**

**Replacement of 60W conventional ceiling fan by 28W BLDC Energy Efficient ceiling fan in Phase manner**

Sr. No	Item	Parameter	Unit
1	Rated Power of Ceiling Fan	60	W
2	No. of Fan	2,600	Nos
3	Working Hrs./Day	8	Hrs./Day
4	Working Days/Year	250	Days/Year
5	Energy Efficient BLDC Fan Rated power	28	W
6	Energy Saving Potential	1,66,400	kWh/Year
7	Load Factor	0.8	
8	Expected Annual Energy Saving	1,33,120	kWh/Year
9	Per Unit Charges	7.41	Rs/kWh
10	Expected Money Saving	9,86,419	Rs./Year
11	Cost of New Ceiling Fan	2,000	Rs./Pices
12	Investment on New Fan Purchasing	52,00,000	Rs.
13	Maintenance Investment@5%	2,60,000	Rs.
14	Total Investment	5,460,000	Rs.
15	Simple Pay Back Period	5.5	Year

**Total Calculated Monetary Saving Potential in Ceiling Fan = Rs 9,86,419/-**

**Note:- Energy savings depend on the operation hour per day and the load factor of the systems.**



**Energy Audit Report  
Mewar University, Gangrar Chittorgarh  
(Rajasthan ) Year 2020-21**



**END OF THE REPORT**

**THANKS**